

AMENDMENT OF SOLICITATION/MODIFICATION OF CONTRACT			1. CONTRACT ID CODE	PAGE 1 OF 6 PAGES
2. AMENDMENT/MODIFICATION NO. AMENDMENT NO. 0002		3. EFFECTIVE DATE 08/27/14	4. REQUISITION/PURCHASE REQ. NO.	5. PROJECT NO. (If applicable) 14-0090
6. ISSUED BY CODE		mks	7. ADMINISTERED BY (If other than Item 6) CODE See Item 6	
Officer in Charge of Construction MCI-East 1005 Michael Road Camp Lejeune, NC 28547-2521				
8. NAME AND ADDRESS OF CONTRACTOR (No., street, county, State and ZIP Code)			(X)	9A. AMENDMENT OF SOLICITATION NO. N40085-14-R-0090
			X	9B. DATED (SEE ITEM 11) 08/20/14
				10A. MODIFICATION OF CONTRACT/ORDER NO.
				10B. DATED (SEE ITEM 11)
CODE	FACILITY CODE			

11. THIS ITEM ONLY APPLIES TO AMENDMENTS OF SOLICITATIONS

The above numbered solicitation is amended as set forth in Item 14. The hour and date specified for receipt of Offers is extended, is not extended.
 Offers must acknowledge receipt of this amendment prior to the hour and date specified in the solicitation or as amended, by one of the following methods:
 (a) By completing items 8 and 15, and returning _____ copies of the amendment; (b) By acknowledging receipt of this amendment on each copy of the offer submitted;
 or (c) By separate letter or telegram which includes a reference to the solicitation and amendment numbers. FAILURE OF YOUR ACKNOWLEDGMENT TO BE RECEIVED AT THE PLACE DESIGNATED FOR THE RECEIPT OF OFFERS PRIOR TO THE HOUR AND DATE SPECIFIED MAY RESULT IN REJECTION OF YOUR OFFER. If by virtue of this amendment your desire to change an offer already submitted, such change may be made by telegram or letter, provided each telegram or letter makes reference to the solicitation and this amendment, and is received prior to the opening hour and date specified.

12. ACCOUNTING AND APPROPRIATION DATA (If required)

**13. THIS ITEM ONLY APPLIES TO MODIFICATION OF CONTRACTS/ORDERS.
IT MODIFIES THE CONTRACT/ORDER NO. AS DESCRIBED IN ITEM 14.**

CHECK ONE	A. THIS CHANGE ORDER IS ISSUED PURSUANT TO: (Specify authority) THE CHANGES SET FORTH IN ITEM 14 ARE MADE IN THE CONTRACT ORDER NO. IN ITEM 10A.
	B. THE ABOVE NUMBERED CONTRACT/ORDER IS MODIFIED TO REFLECT THE ADMINISTRATIVE CHANGES (such as changes in paying office, appropriation date, etc.) SET FORTH IN ITEM 14, PURSUANT TO THE AUTHORITY OF FAR 43.103(b).
	C. THIS SUPPLEMENTAL AGREEMENT IS ENTERED INTO PURSUANT TO AUTHORITY OF:
	D. OTHER (Specify type of modification and authority)

E. IMPORTANT: Contractor is not, is required to sign this document and return _____ copies to the issuing office.

14. DESCRIPTION OF AMENDMENT/MODIFICATION (Organized by UCF section headings, including solicitation/contract subject matter where feasible.)

14-0090 Interior/Exterior Repairs, Building FC120

(CONTINUED)


Except as provided herein, all terms and conditions of the document referenced in Item 9A or 10A, as heretofore changed, remains unchanged and in full force and effect.

15A. NAME AND TITLE OF SIGNER (Type or print)		16A. NAME AND TITLE OF CONTRACTING OFFICER (Type or print)	
15B. CONTRACTOR/OFFEROR		16B. UNITED STATES OF AMERICA	
15C. DATE SIGNED		16C. DATE SIGNED	
(Signature of person authorized to sign)		(Signature of Contracting Officer)	


Incorporate revised sheets FA-1, FA-2, FP-1, and FP-2 into the project/contract.

1. FA-2: Provide/install a fire alarm pull station in Storage room 102 on west wall adjacent to the door leading to stairwell.
2. FA-2: Provide/install a speaker strobe in room 114 on west wall adjacent to door.
3. FA-2: Provide/install a FAD beside the new FMCP.
4. FA-2: Provide/install a speaker strobe in room 107 on east wall.
5. FP-2: New Wet Pipe Riser-Omit the Alarm Check Valve and replace with a Flow Switch.

SYM	REVISIONS	DATE	APPROVED
△	MASS NOTE/SPARWAR COORDINATION	8/13	

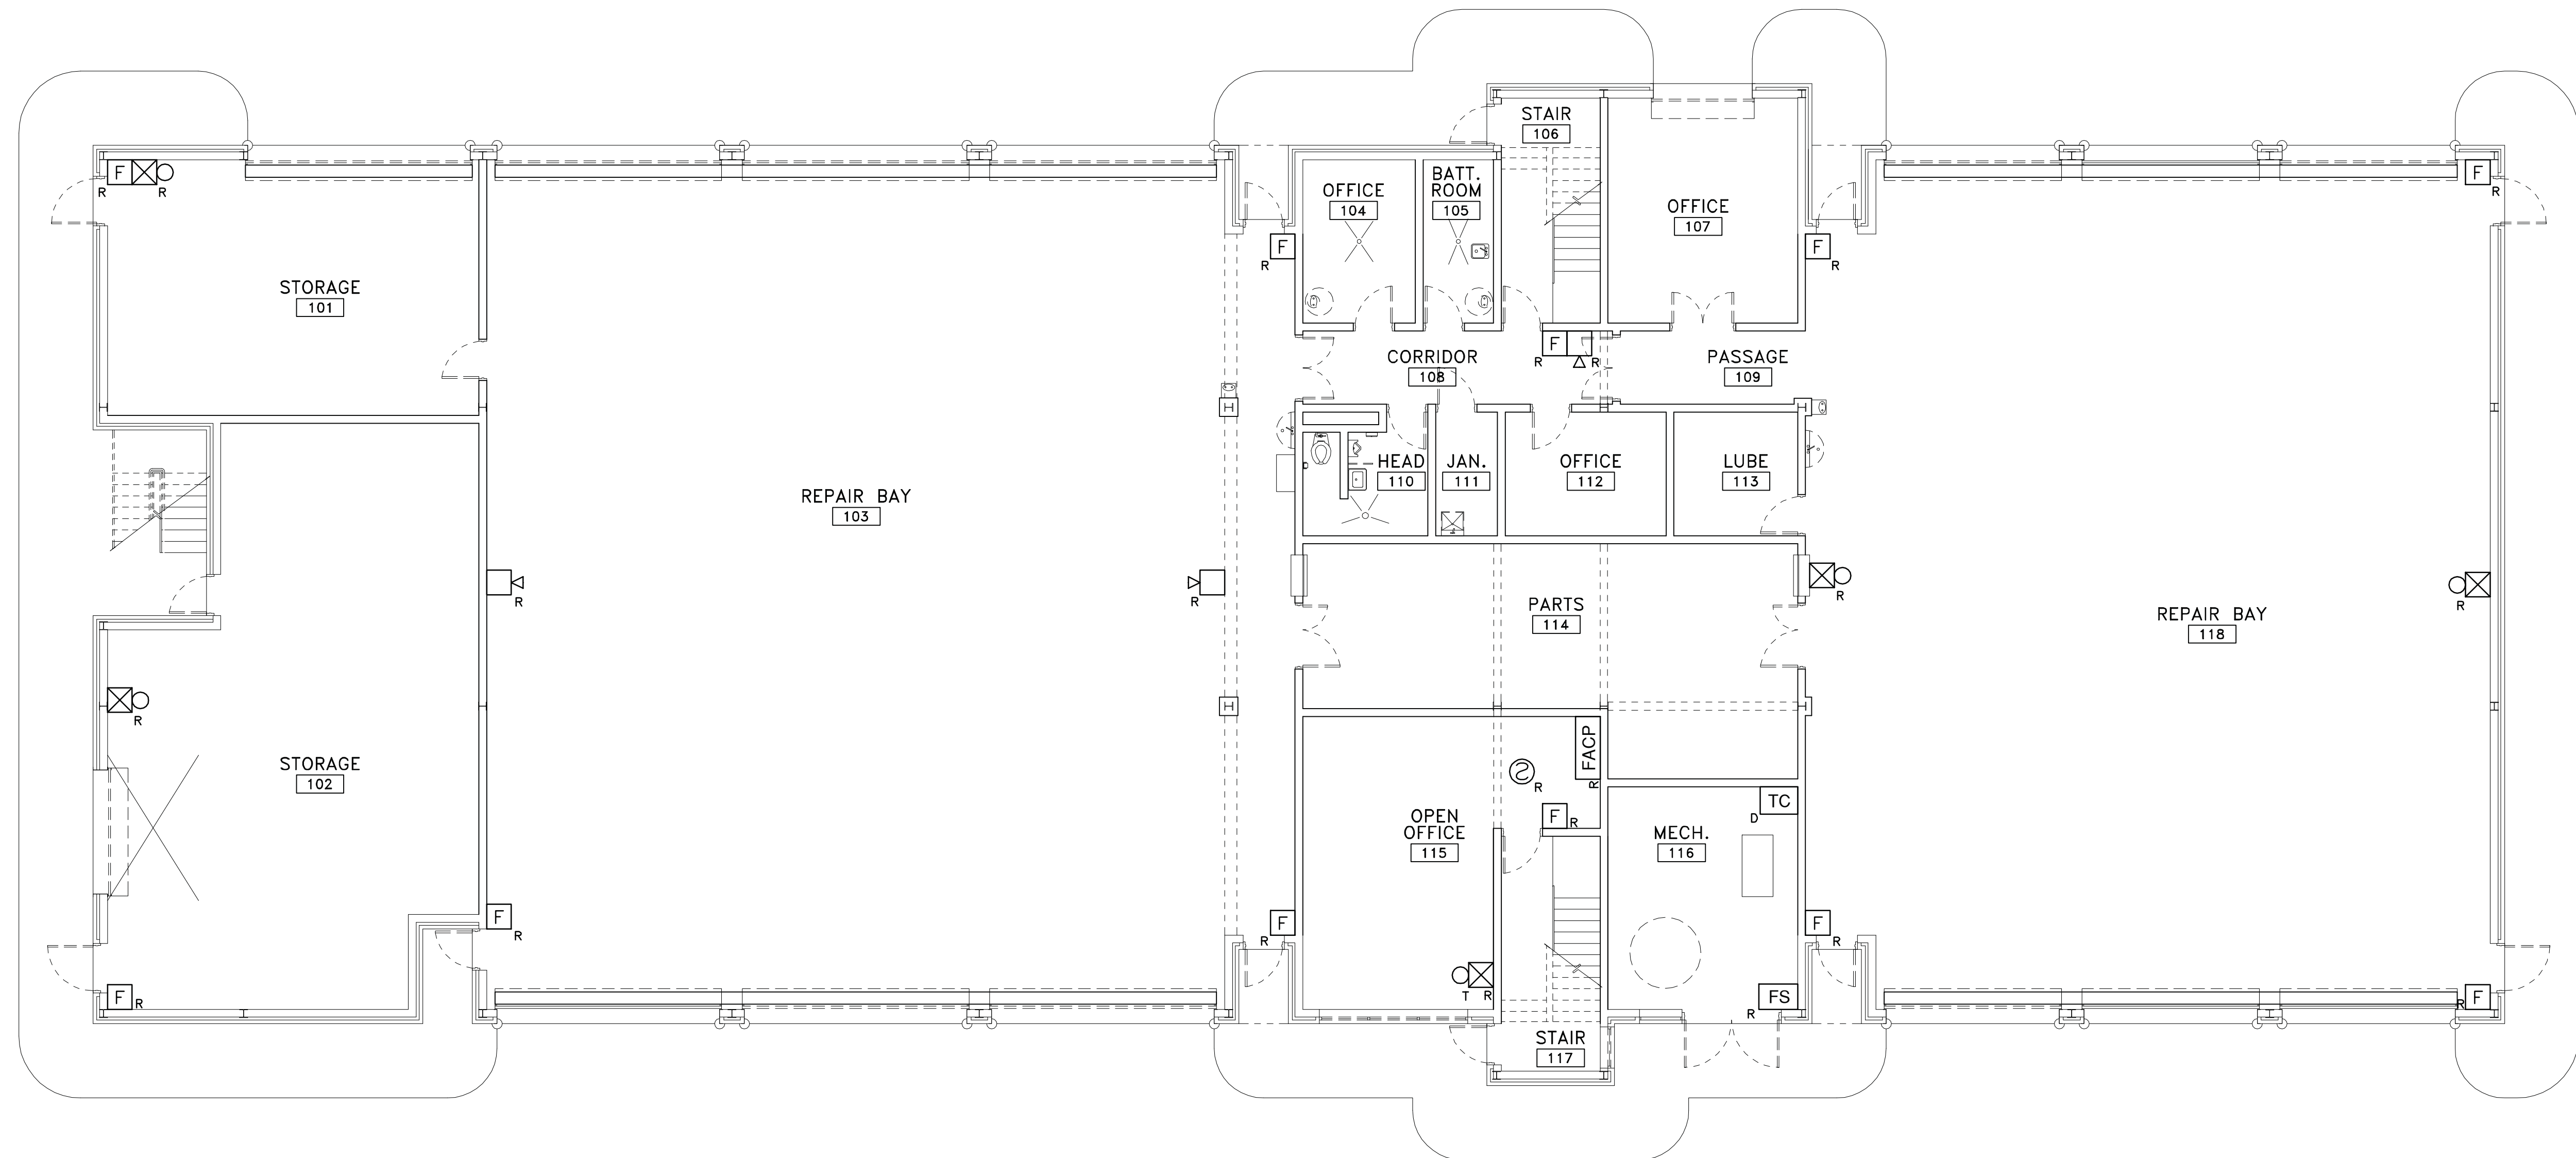

A FIRE ALARM DEMOLITION 1ST FLOOR PLAN
1/8" = 1'-0"

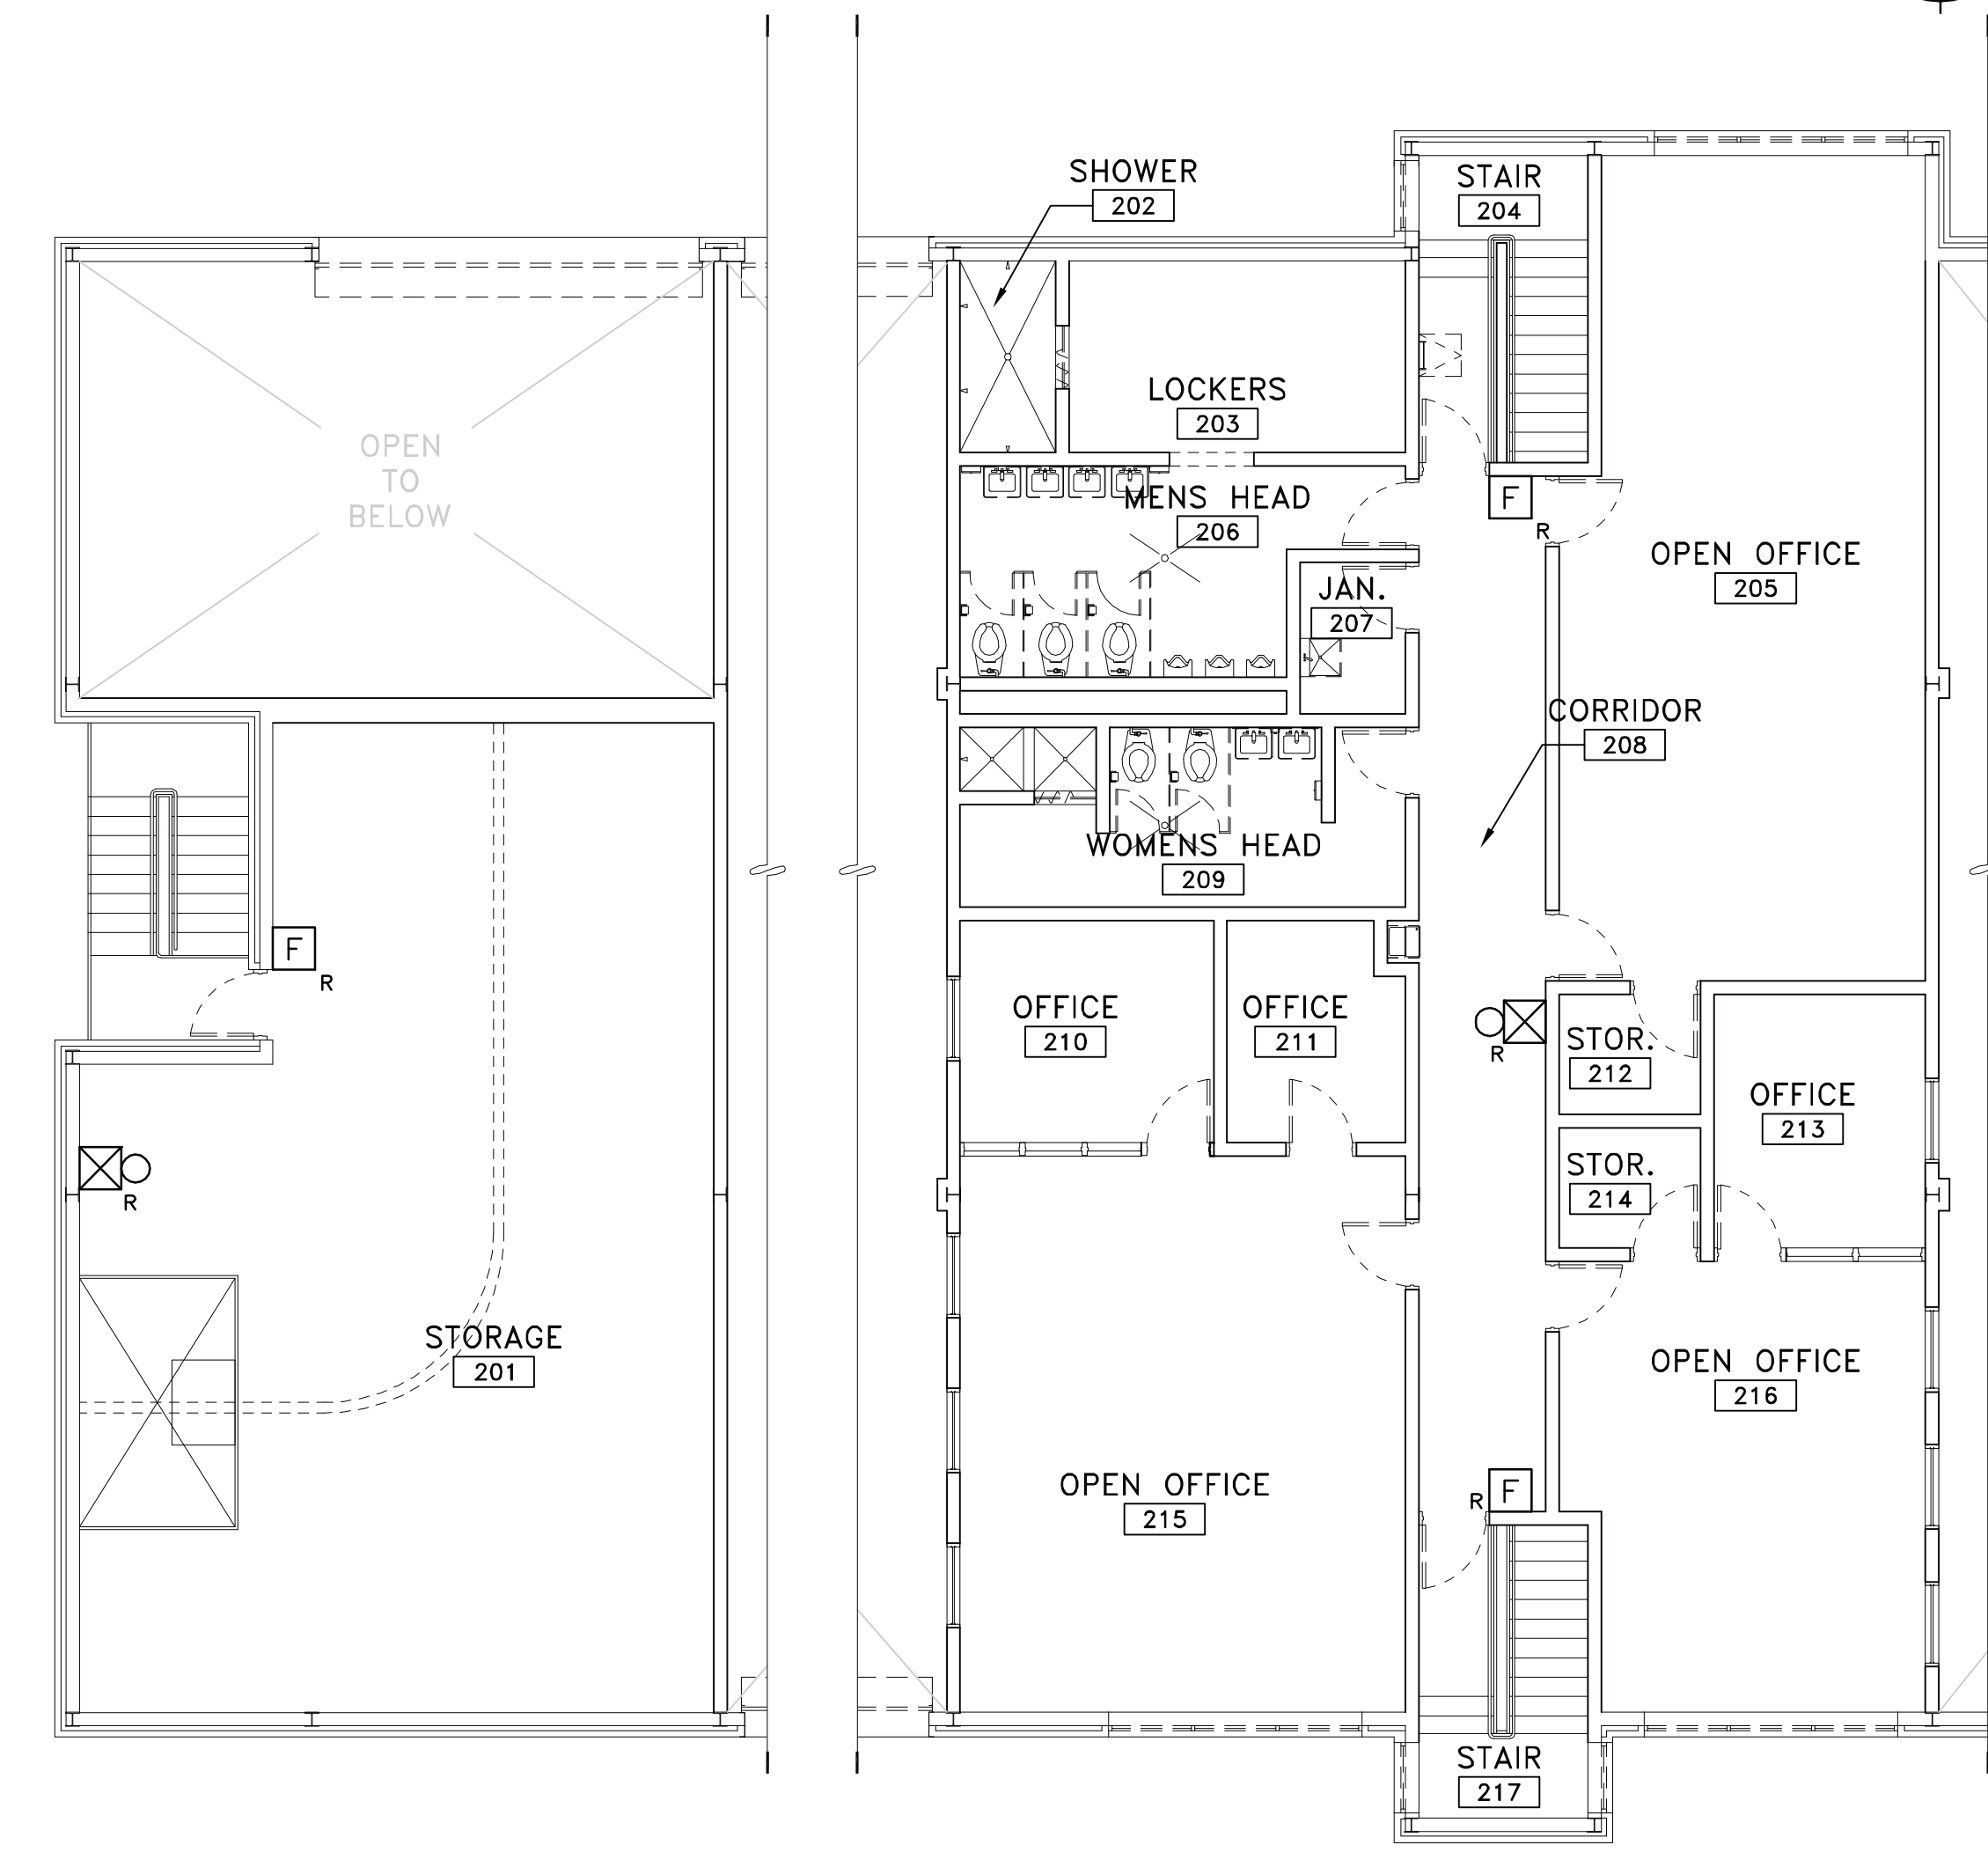

B FIRE ALARM DEMOLITION 2ND FLOOR PLAN
1/8" = 1'-0"

- LEGEND**
- ⊗ BELL
 - F FIRE ALARM PULL STATION
 - ⊗ SPEAKER STROBE
 - ⊞ SPEAKER
 - UH GAS FIRED APPLIANCE
 - ⊙ CARBON MONOXIDE DETECTOR
 - ⊙ SMOKE DETECTOR
 - ⊙ IN-DUCT SMOKE DETECTOR
 - FACP FIRE ALARM CONTROL PANEL
 - FMCP FIRE ALARM MASS NOTIFICATION CONTROL PANEL
 - ACU AUTONOMOUS CONTROL UNIT
 - TRNS MASS NOTIFICATION TRANSCIVER
 - BAT BATTERIES
 - TS TAMPER SWITCH MONITORING MODULE
 - FS FLOW SWITCH MONITORING MODULE
 - M/C MICROPHONE
 - S/P SURGE PROTECTOR
 - DACT DIGITAL ALARM COMMUNICATOR TRANSMITTER
 - FAD FIRE ALARM DOCUMENTS △
 - TC TERMINAL CABINET
 - △ FIRE DEPARTMENT KNOX BOX
 - B 24 VDC WATER ALARM BELL
 - HVAC ZONE
 - EMT 4"x4"x2" EMT BOX △

- SUBSCRIPTS**
- WP - WEATHERPROOF
 - R - TO REPLACE IN CURRENT LOCATION WITH A NEW DEVICE △
 - D - TO DELETE + REPAIR FINISH
 - N - NEW DEVICE LOCATION
 - T - TROUBLE

DEMOLITION NOTES:

1. REMOVE ALL EXISTING FIRE ALARM DEVICES, JUNCTION BOXES AND ASSOCIATED WIRING, UNLESS NOTED OTHERWISE.
2. REMOVE ABANDONED CONDUIT WHERE FEASIBLE. △
3. CONTRACTOR SHALL FIELD VERIFY EXISTING CONDITIONS THAT MAY AFFECT THE SYSTEM INSTALLATION OR COMPLIANCE WITH NFPA 72, AND NOTIFY THE CONTRACTING OFFICER PRIOR TO BEGINNING WORK.
4. REPAIR INTERIOR FINISHES WHERE DAMAGED FROM DEMOLITION.
5. EXISTING CONDUIT AND JUNCTION BOXES MAY BE RE-USED IF IN COMPLIANCE WITH CURRENT CODES.


GENERAL NOTES:

- 1.
- 2.
3. INSTALL A NEW COMPLETE ADDRESSABLE FIRE ALARM AND MASS NOTIFICATION SYSTEM IN COMPLIANCE WITH NFPA 72-2013 EDITION AND NFPA 70-2014 EDITION FOR AN EMERGENCY VOICE ALARM COMMUNICATION SYSTEM. THE SYSTEM SHALL INTEGRATE WITH THE INSTALLATION BASE-WIDE MASS NOTIFICATION SYSTEM (WAVES). △
4. STROBE CANDELA RATING IS TO BE DETERMINED BY THE CONTRACTOR IN ACCORDANCE WITH NFPA 72.
5. ALL NEW CONDUIT, WIRE AND CABLES SHALL BE CONCEALED IN WALLS, CEILING SPACES, ELECTRICAL SHAFTS OR CLOSETS. NEW CONDUIT MAY BE EXPOSED IN UNFINISHED AREA. PAINTED SURFACE WIRE MOLD MAY BE USED IN FINISHED AREAS WHERE IT IS NOT FEASIBLE TO CONCEAL CONDUIT AND WIRING. RUN ALL WIRE IN MINIMUM 3/4" METAL CONDUIT.
6. △
7. RUN TWO CAT 6e LINES IN 1" CONDUIT FROM THE DACT TO THE TERMINAL BLOCK, COORDINATE WITH CONTRACTING OFFICER THE LOCATION OF THE TERMINAL BLOCK.
8. FIRE ALARM CONTROL PANEL TO BE COMPATIBLE WITH A SUR-GUARD SYSTEM III MULTI-PLATFORM DIGITAL TELEPHONE RECEIVER. SHALL BE CAPABLE OF ACCEPTING AN AUXILIARY LINE LEVEL AUDIO INPUT (.775 VRMS). SHALL BE CONFIGURED TO ACCEPT DRY CONTACT INPUT FROM A TRX-401 INTERFACE TO ALERT THE PANEL A MNS MESSAGE IS FORTHCOMING. △
9. CONTRACTOR SHALL FIELD VERIFY EXISTING CONDITIONS THAT MAY AFFECT THE SYSTEM INSTALLATION OR COMPLIANCE WITH NFPA 72, AND NOTIFY THE CONTRACTING OFFICER PRIOR TO BEGINNING WORK.
10. ENSURE SPEAKERS IN THE VICINITY OF THE ACU WILL NOT CREATE ACOUSTICAL FEEDBACK OR OTHERWISE INTERFERE WITH THE ABILITY TO DELIVER LIVE VOICE MESSAGE.
11. COORDINATE THE NUMBER AND LOCATION OF IN-DUCT SMOKE DETECTORS WITH MECHANICAL SYSTEMS.
12. CONTRACTOR SHALL PROVIDE ALL EQUIPMENT AND LABOR REQUIRED TO CONNECT THE NEW FIRE ALARM AND DETECTION SYSTEM TO THE BASE'S SUPERVISING STATION. ALL FIRE ALARM PANEL POINTS MUST BE PROGRAMMED AS INDIVIDUAL POINTS AT THE HEAD END. THE CONTRACTOR IS RESPONSIBLE FOR PROGRAMMING THE FIRE ALARM AND PERFORMING SETTINGS AND HEAD END EQUIPMENT.
13. CONTRACTOR SHALL PROVIDE 1-1/2" RMC FROM THE MNS ENCLOSURE TO A POINT 4 FEET ABOVE THE PEAK OF THE ROOF LINE. INSTALL THE RMC IN THE MOST DIRECT VERTICAL ROUTE POSSIBLE. IF SHARP BENDS ARE REQUIRED, UTILIZE PULL BOXES APPROPRIATELY. TERMINATE THE TOP OF THE EXTERIOR RMC WITH A U.L. LISTED WEATHER HEAD. INSTALL 50 OHM, LMR-400 RF CABLE IN THE RMC. PROVIDE A 3 FT. CABLE LENGTH MAINTENANCE LOOP AT BOTH ENDS OF THE CABLE ROUTE. TERMINATE ROOF CABLE WITH A STRAIGHT MALE N-TYPE CONNECTOR. CLEARLY LABEL THE RF CABLE "FOR MNS" AT THE MNS MOUNTING AREA. TEST RF CABLE FOR PROPER CONNECTIVITY. INSTALL ONE 9DBI OMNI-DIRECTIONAL ANTENNA, MOBILE MARK OD9-2400 OR EQUIVALENT ON TOP OF ROOF TOP ANTENNA MAST.
14. CONTRACTOR IS RESPONSIBLE FOR PROVIDING SPEAKERS FOR MASS NOTIFICATION SYSTEM INTELLIGIBILITY REQUIREMENTS.
15. CONTRACTOR SHALL DRESS AND SECURE ALL WIRES, CONDUIT, CABLES AND EQUIPMENT IN A NEAT AND PROFESSIONAL MANNER.
16. EMT FLUSH MOUNTED BOX SHALL BE MOUNTED AT A HEIGHT CONSISTENT WITH THE FIRE ALARM NOTIFICATION DEVICES. PROVIDE BOX WITH A BLANK COVER LABELED "FOR MNS USE".
17. CARBON MONOXIDE DETECTORS SHALL BE LOCATED FOR EASY MAINTENANCE, BUT SHALL NOT BE WITHIN 10 FEET OF ANY FUEL FIRED APPLIANCE.
18. THE TRX-401 WILL BE SUPPLIED UNDER A SEPARATE CONTRACT. △

DISCLOSURE OF INFORMATION
CONTRACTOR SHALL COMPLY AS FOLLOWS:
(A) THE CONTRACTOR SHALL NOT RELEASE TO ANYONE OUTSIDE THE CONTRACTOR'S ORGANIZATION ANY UNCLASSIFIED INFORMATION, REGARDLESS OF MEDIUM (E.G., FILM, TAPE, DOCUMENT), PERTAINING TO ANY PART OF THIS CONTRACT OR ANY PROGRAM RELATED TO THIS CONTRACT, UNLESS:
(1) THE CONTRACTING OFFICER HAS GIVEN PRIOR WRITTEN APPROVAL OR
(2) THE INFORMATION IS OTHERWISE IN THE PUBLIC DOMAIN BEFORE THE DATE OF RELEASE
(B) REQUESTS FOR APPROVAL SHALL IDENTIFY THE SPECIFIC INFORMATION TO BE RELEASED, THE MEDIUM TO BE USED, AND THE PURPOSE FOR THE RELEASE. THE CONTRACTOR SHALL SUBMIT ITS REQUEST TO THE CONTRACTING OFFICER AT LEAST 45 DAYS BEFORE THE PROPOSED DATE FOR RELEASE
(C) THE CONTRACTOR AGREES TO INCLUDE A SIMILAR REQUIREMENT IN EACH SUBCONTRACT UNDER HIS CONTRACT. SUBCONTRACTORS SHALL SUBMIT REQUESTS FOR AUTHORIZATION TO RELEASE THROUGH THE PRIME CONTRACTOR TO THE CONTRACTING OFFICER.


FA-1

 The Walker Group Architecture, Inc. WALKER GROUP ARCHITECTURE PO Box 541, New Bern, NC 28563 252.636.8778 (PHONE) 252.636.8992 (FAX)	DEPARTMENT OF THE NAVY NAVAL FACILITIES ENGINEERING COMMAND MARINE CORPS BASE CAMP LEJEUNE, NORTH CAROLINA	
	14-0090 INTERIOR AND EXTERIOR REPAIRS, BLDG. FC120 FIRE ALARM DEMOLITION FLOOR PLAN	
DES. J. LOVETT DR. D. NAM CHK. K. COLLINS SUBMITTED BY: X. XXXXX DESIGN DIR. X. XXXXX APPROVED: PWO OR OICC SATISFACTORY TO:	DATE: _____ DATE: _____ DATE: _____	SIZE: CODE IDENT. NO. 60015348 NAVFAC DRAWING NO. 60015348 CONST. CONTR. NO. N40085-14-B-0090 SCALE: NOTED SPEC. 05-14-0090 SHEET 4 OF 41

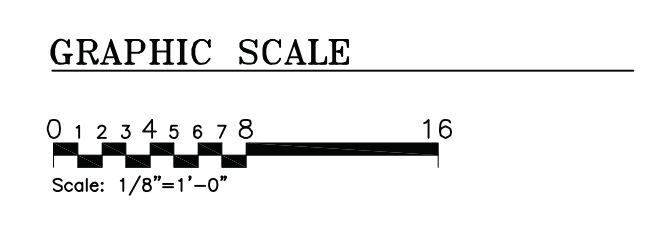

BUILDING SPRINKLERED THROUGHOUT


SYM	REVISIONS	DATE	APPROVED
△	MASS NOTE/SPARWAR COORDINATION	8/13	

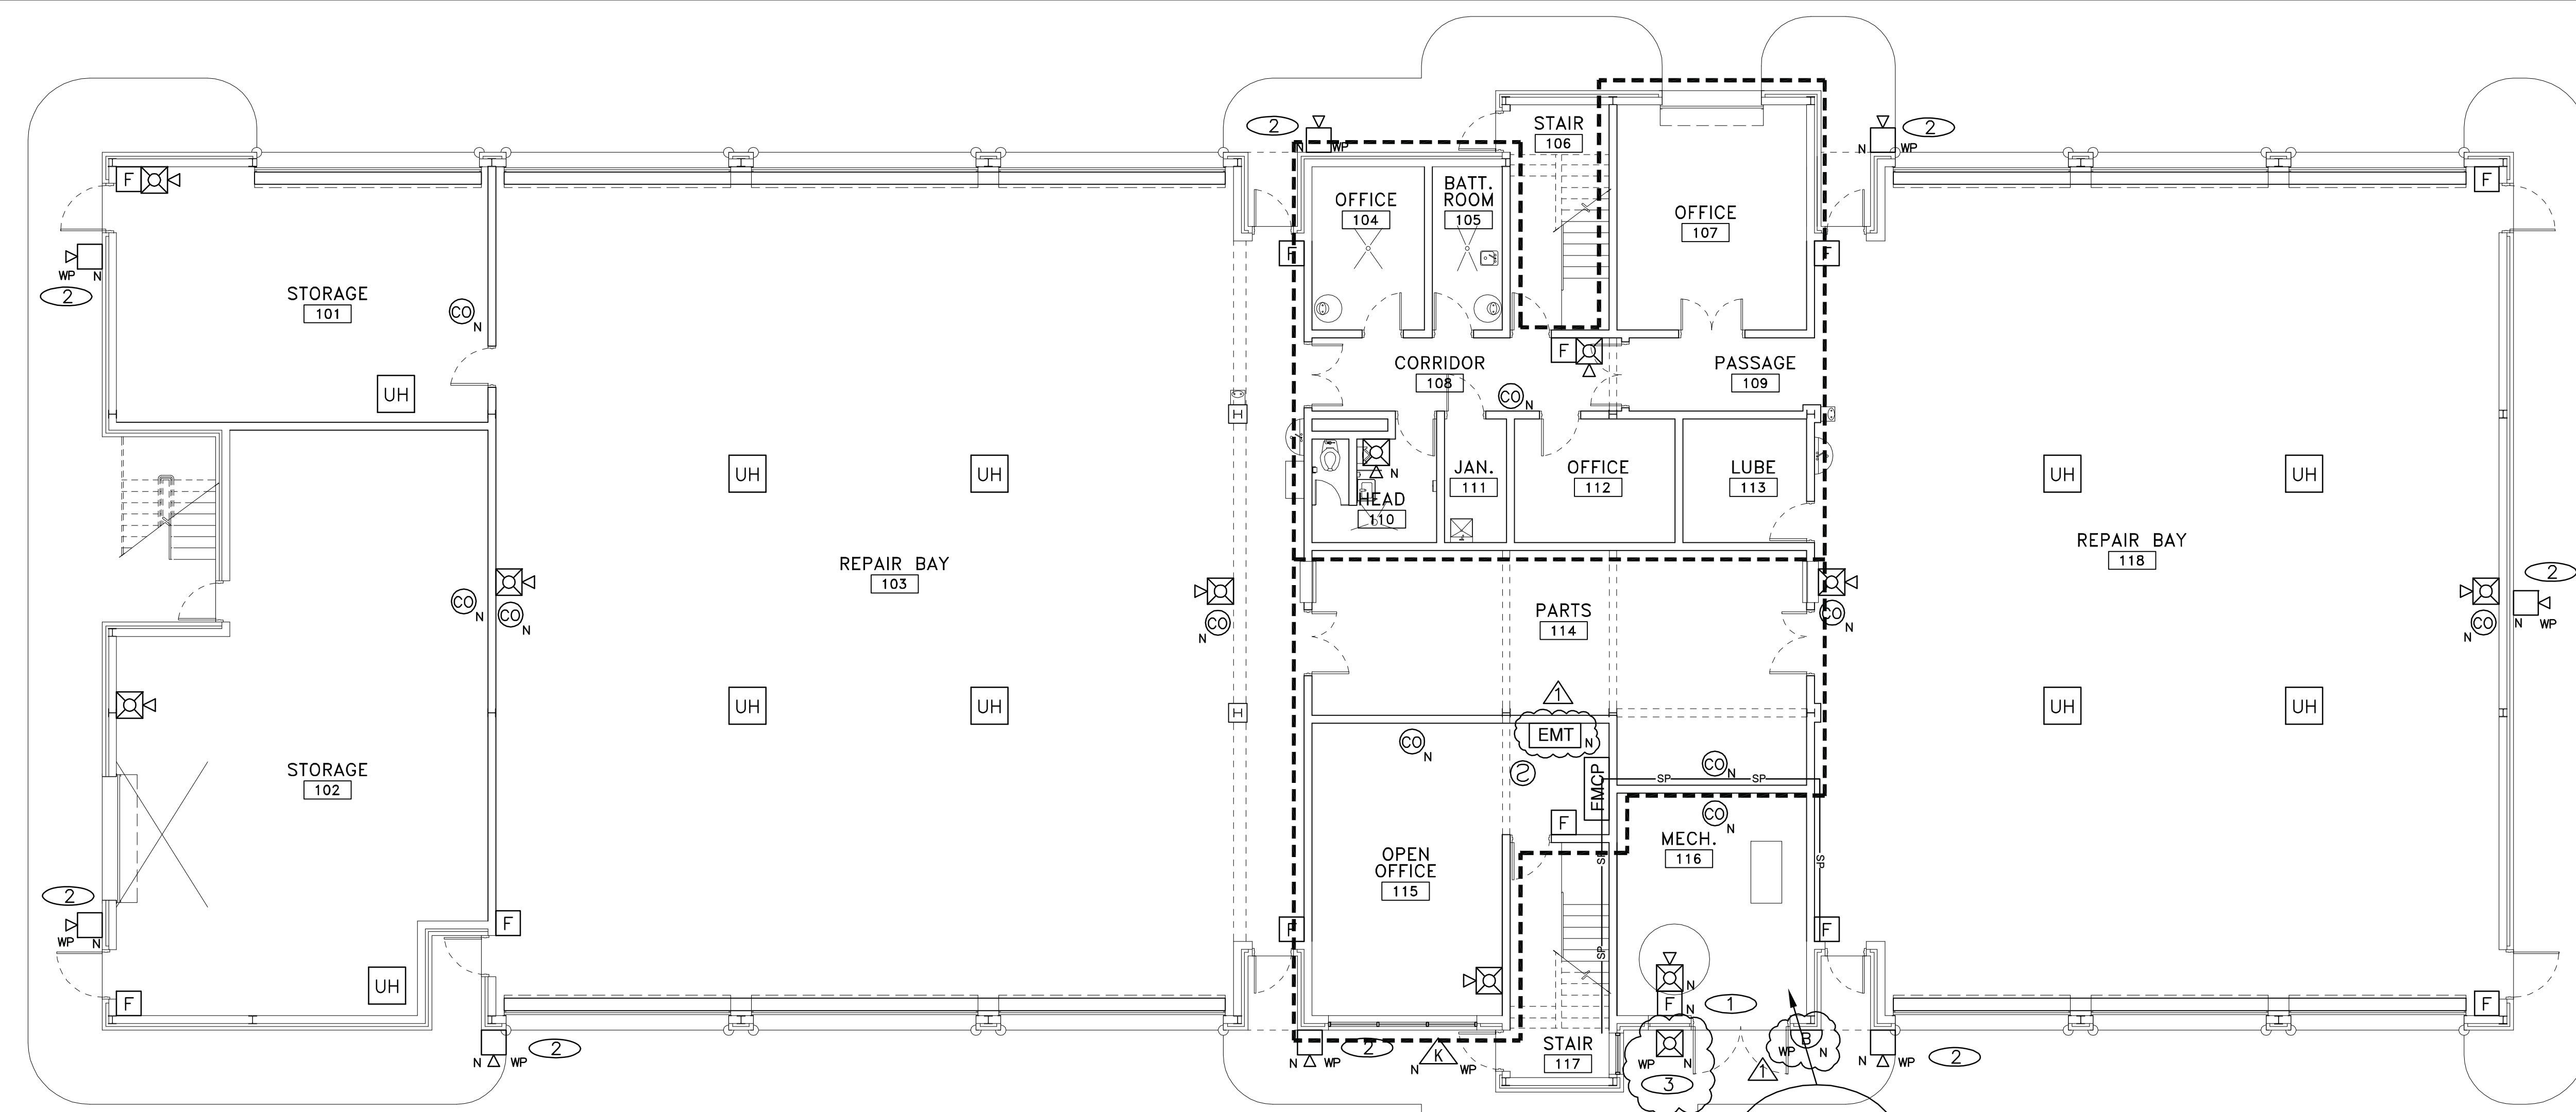

A FIRE ALARM RENOVATION 1ST FLOOR PLAN
 1/8" = 1'-0"


ACTION TO BE INITIATED	ACTUATE AUDIBLE & VISUAL ALARM SIGNAL INDICATOR & ALARM @ FMCP	ACTUATE AUDIBLE & VISUAL SUPERVISORY SIGNAL INDICATOR & ALARM @ FMCP	ACTUATE AUDIBLE & VISUAL TROUBLE SIGNAL INDICATOR & ALARM @ FMCP	DISPLAY/PRINT CHANGE OF STATUS ON FMCP	TRANSMIT SIGNAL TO MONITORING STATION	ACTUATE FIRE ALARM AUDIBLE MESSAGE	ACTIVATE ALERT VISUAL APPLIANCES	INITIATE SHUT DOWN OF ASSOCIATED AHU	OVERRIDE / SILENCE BUILDING FA SYSTEM / MUSIC/TV'S	OVERRIDE PRE-RECORDED DIGITIZED VOICE MESSAGE	OVERRIDE FIRE ALARM AUDIBLE SIGNALS	BROADCAST MNS AUDIBLE MESSAGE	BROADCAST CO AUDIBLE MESSAGE	ACTUATE EXTERIOR AUDIBLE/VISUAL WATERFLOW ALARM DEVICES
MANUAL PULL STATION	X			X	X	X	X		X					
GENERAL SMOKE DETECTOR	X			X	X	X	X		X					
DUCT SMOKE DETECTOR		X		X	X			X						
WATERFLOW SWITCH	X			X	X	X	X		X					X
TAMPER SWITCH		X		X	X									
FIRE ALARM AC POWER FAILURE				X	X	X								
FIRE ALARM SYS LOW BATTERY				X	X	X								
OPEN CIRCUIT/ GROUND FAULT				X	X	X								
NOTIFICATION APPLIANCE SHORT				X	X	X								
LIVE VOICE MESSAGE		X		X	X		X		X	X	X			
MNS AUTONOMOUS CONTROL UNIT		X		X	X		X		X		X	X		
CARBON MONOXIDE DETECTOR	X			X	X		X		X				X	

E OPERATIONAL MATRIX
 FA 2 NTS

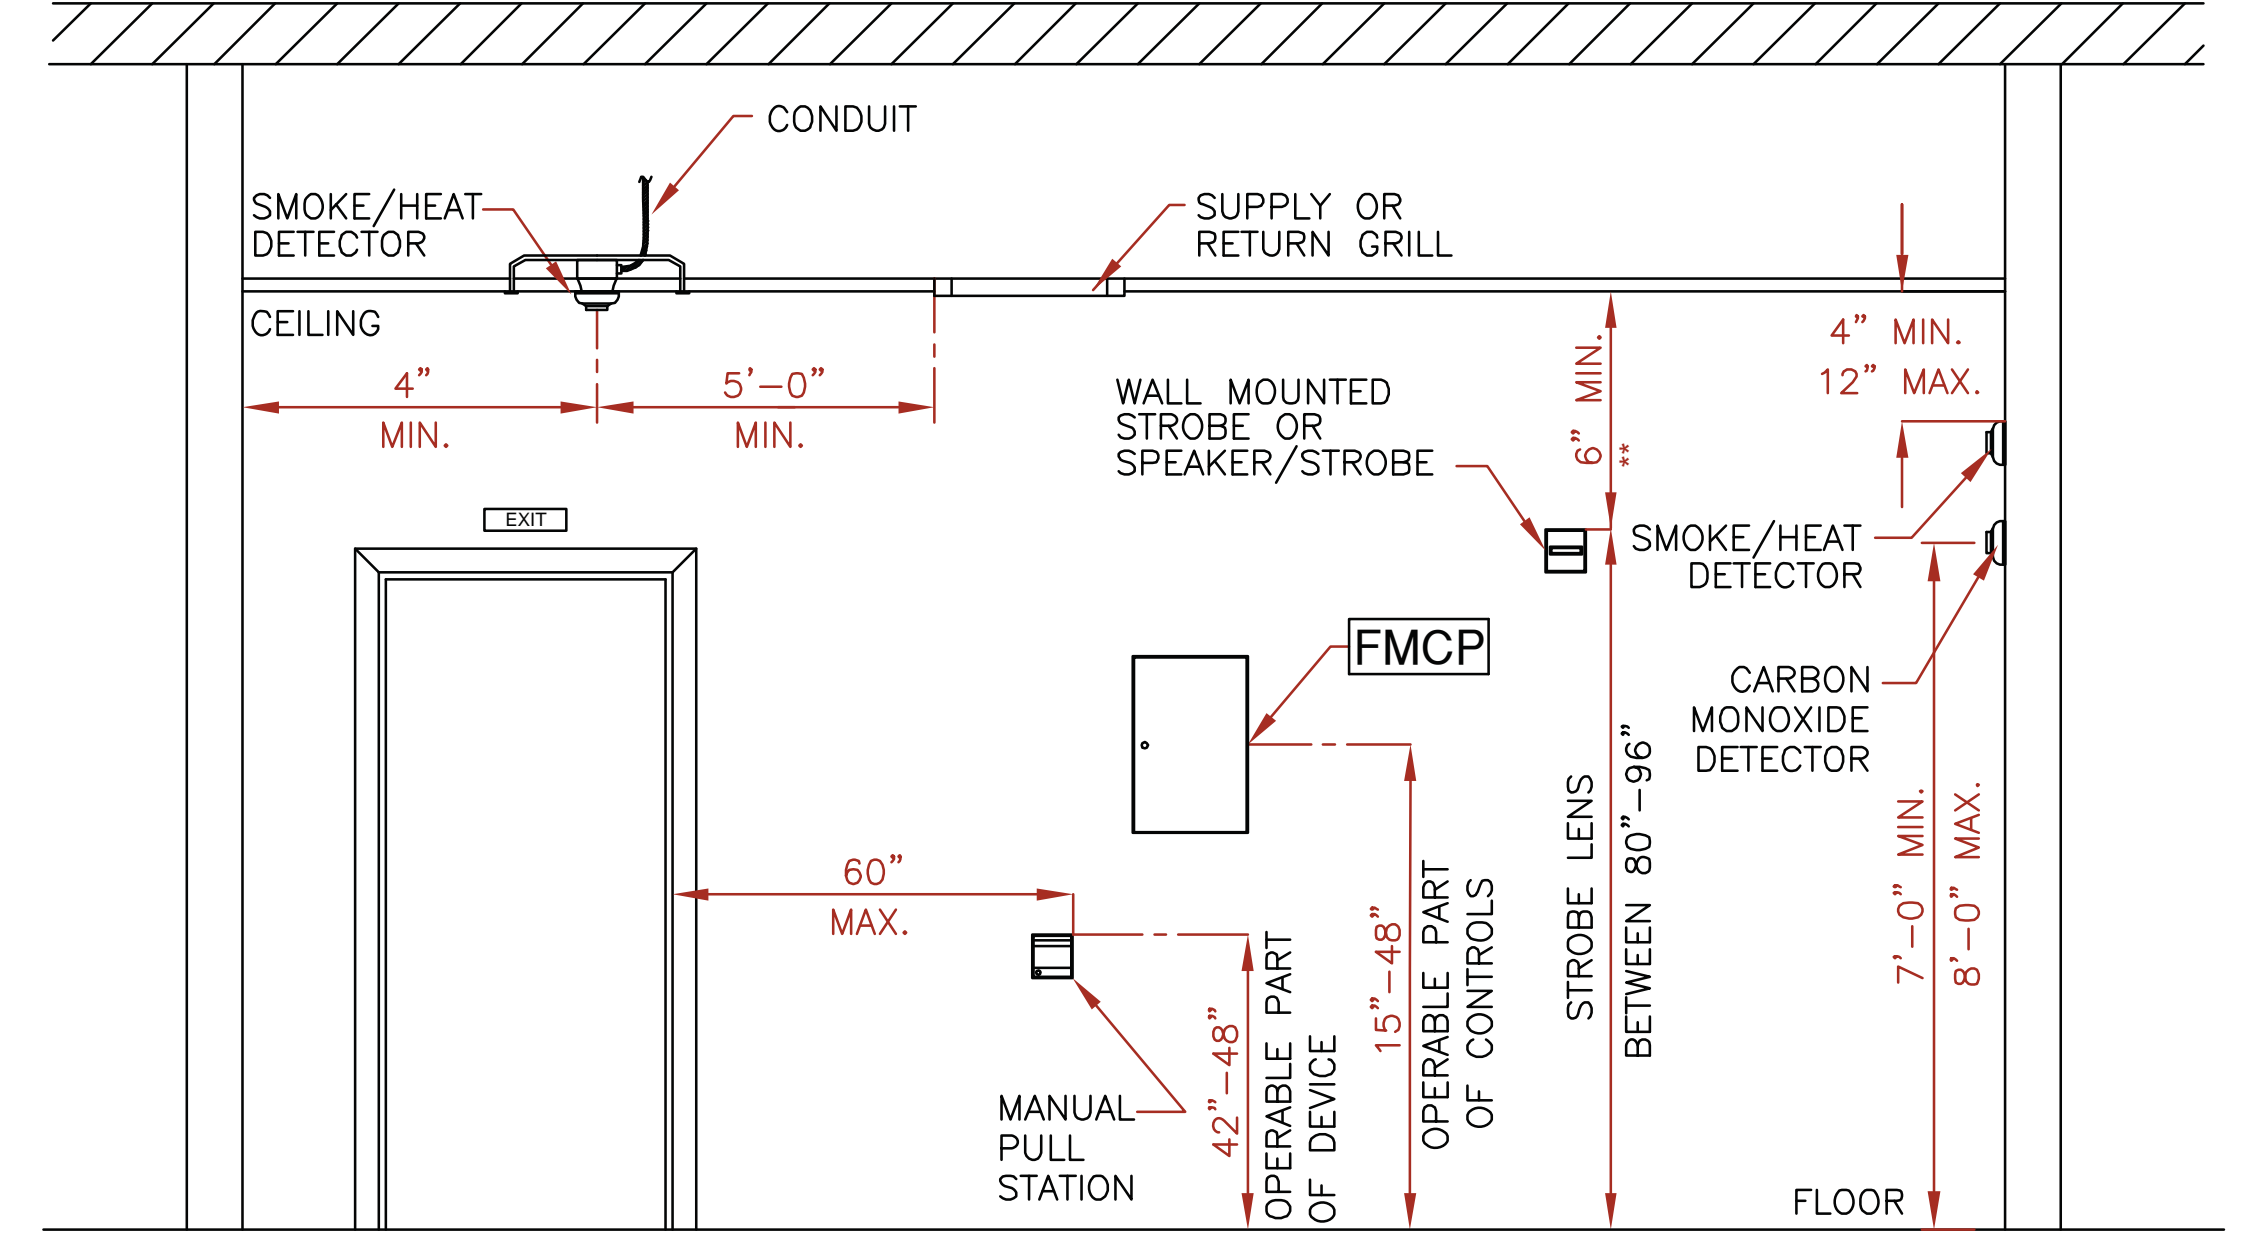


D MOUNTING HEIGHT
 FA 2 NTS


- KEY NOTES:**
- 1 PROVIDE A MANUAL STATION CONNECTED TO A SEPARATE CIRCUIT THAT IS NOT PLACED "ON TEST" WHEN THE FIRE ALARM SYSTEM IS PLACED "ON TEST".
 - 2 INSTALL COOPER WHELOCK SERIES STH-15S SUPERVISED HORN LOUDSPEAKER OUTSIDE OF BUILDING.
 - 3 PROVIDE WATERFLOW WARNING STROBE MOUNTED OUTSIDE OF ROOM 116 ADJACENT TO WATERFLOW ALARM BELL. SEE SPECIFICATIONS FOR ADDITIONAL INFORMATION.

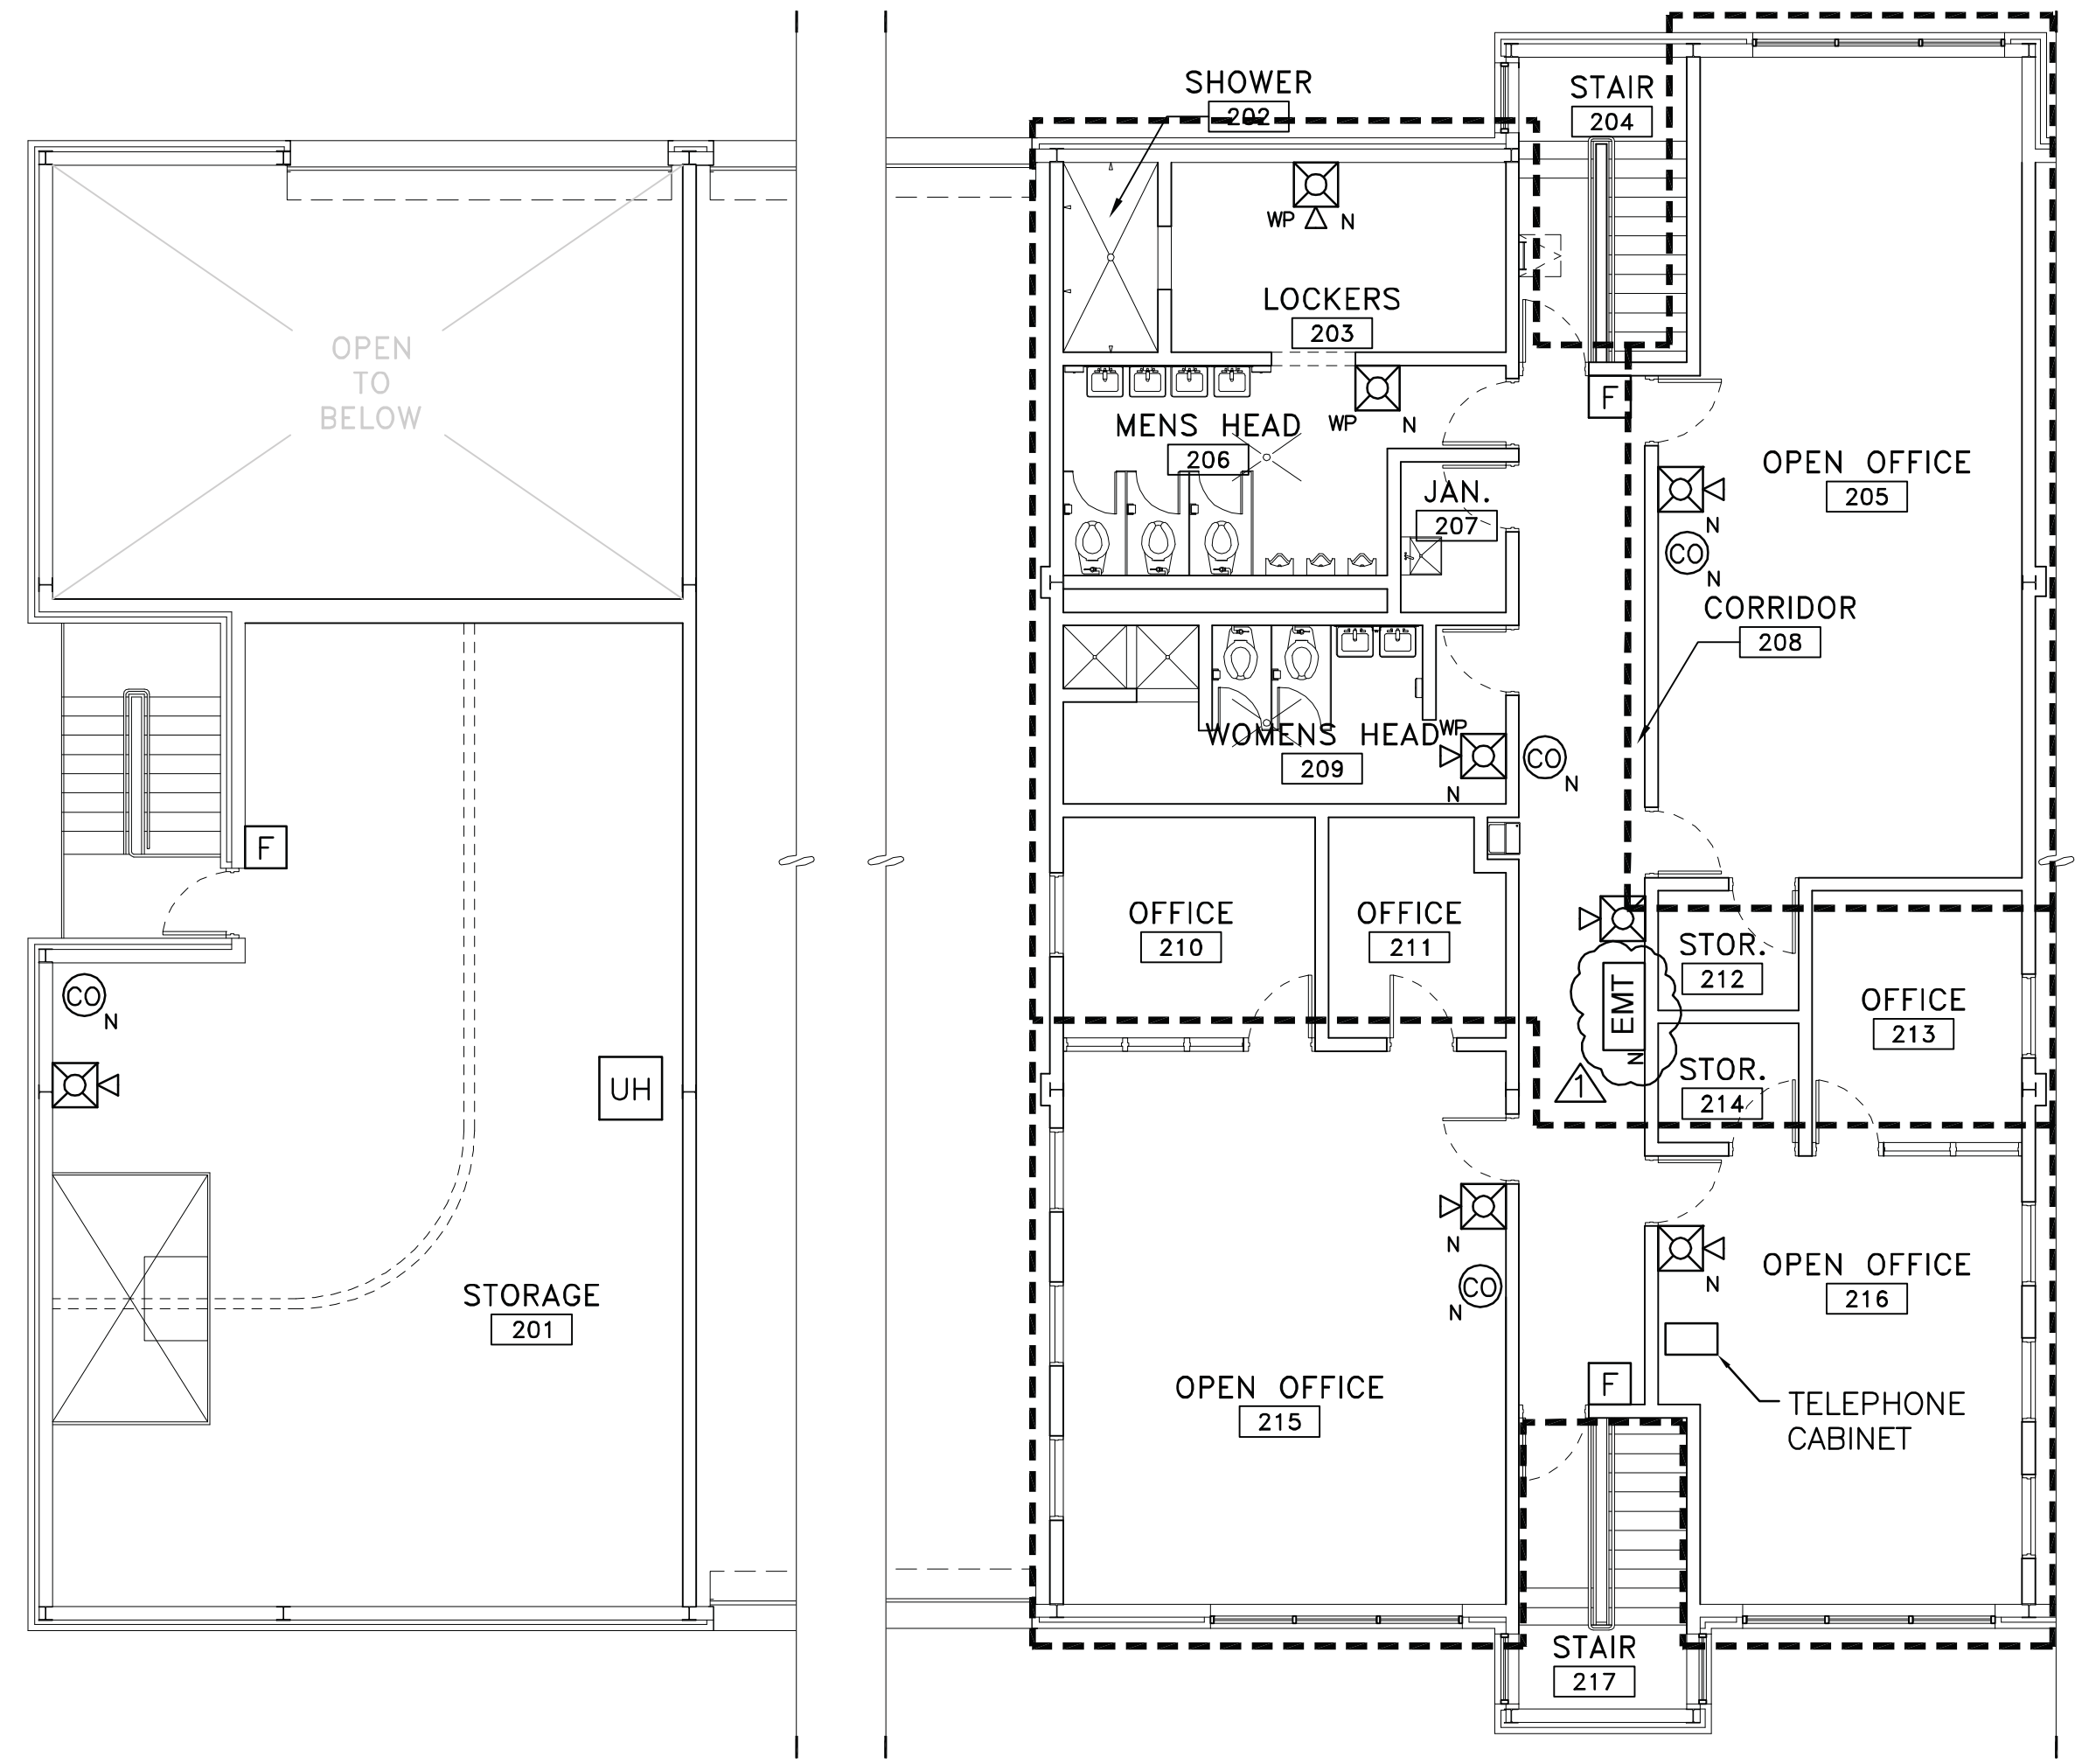

B FIRE ALARM RENOVATION 2ND FLOOR PLAN
 1/8" = 1'-0"

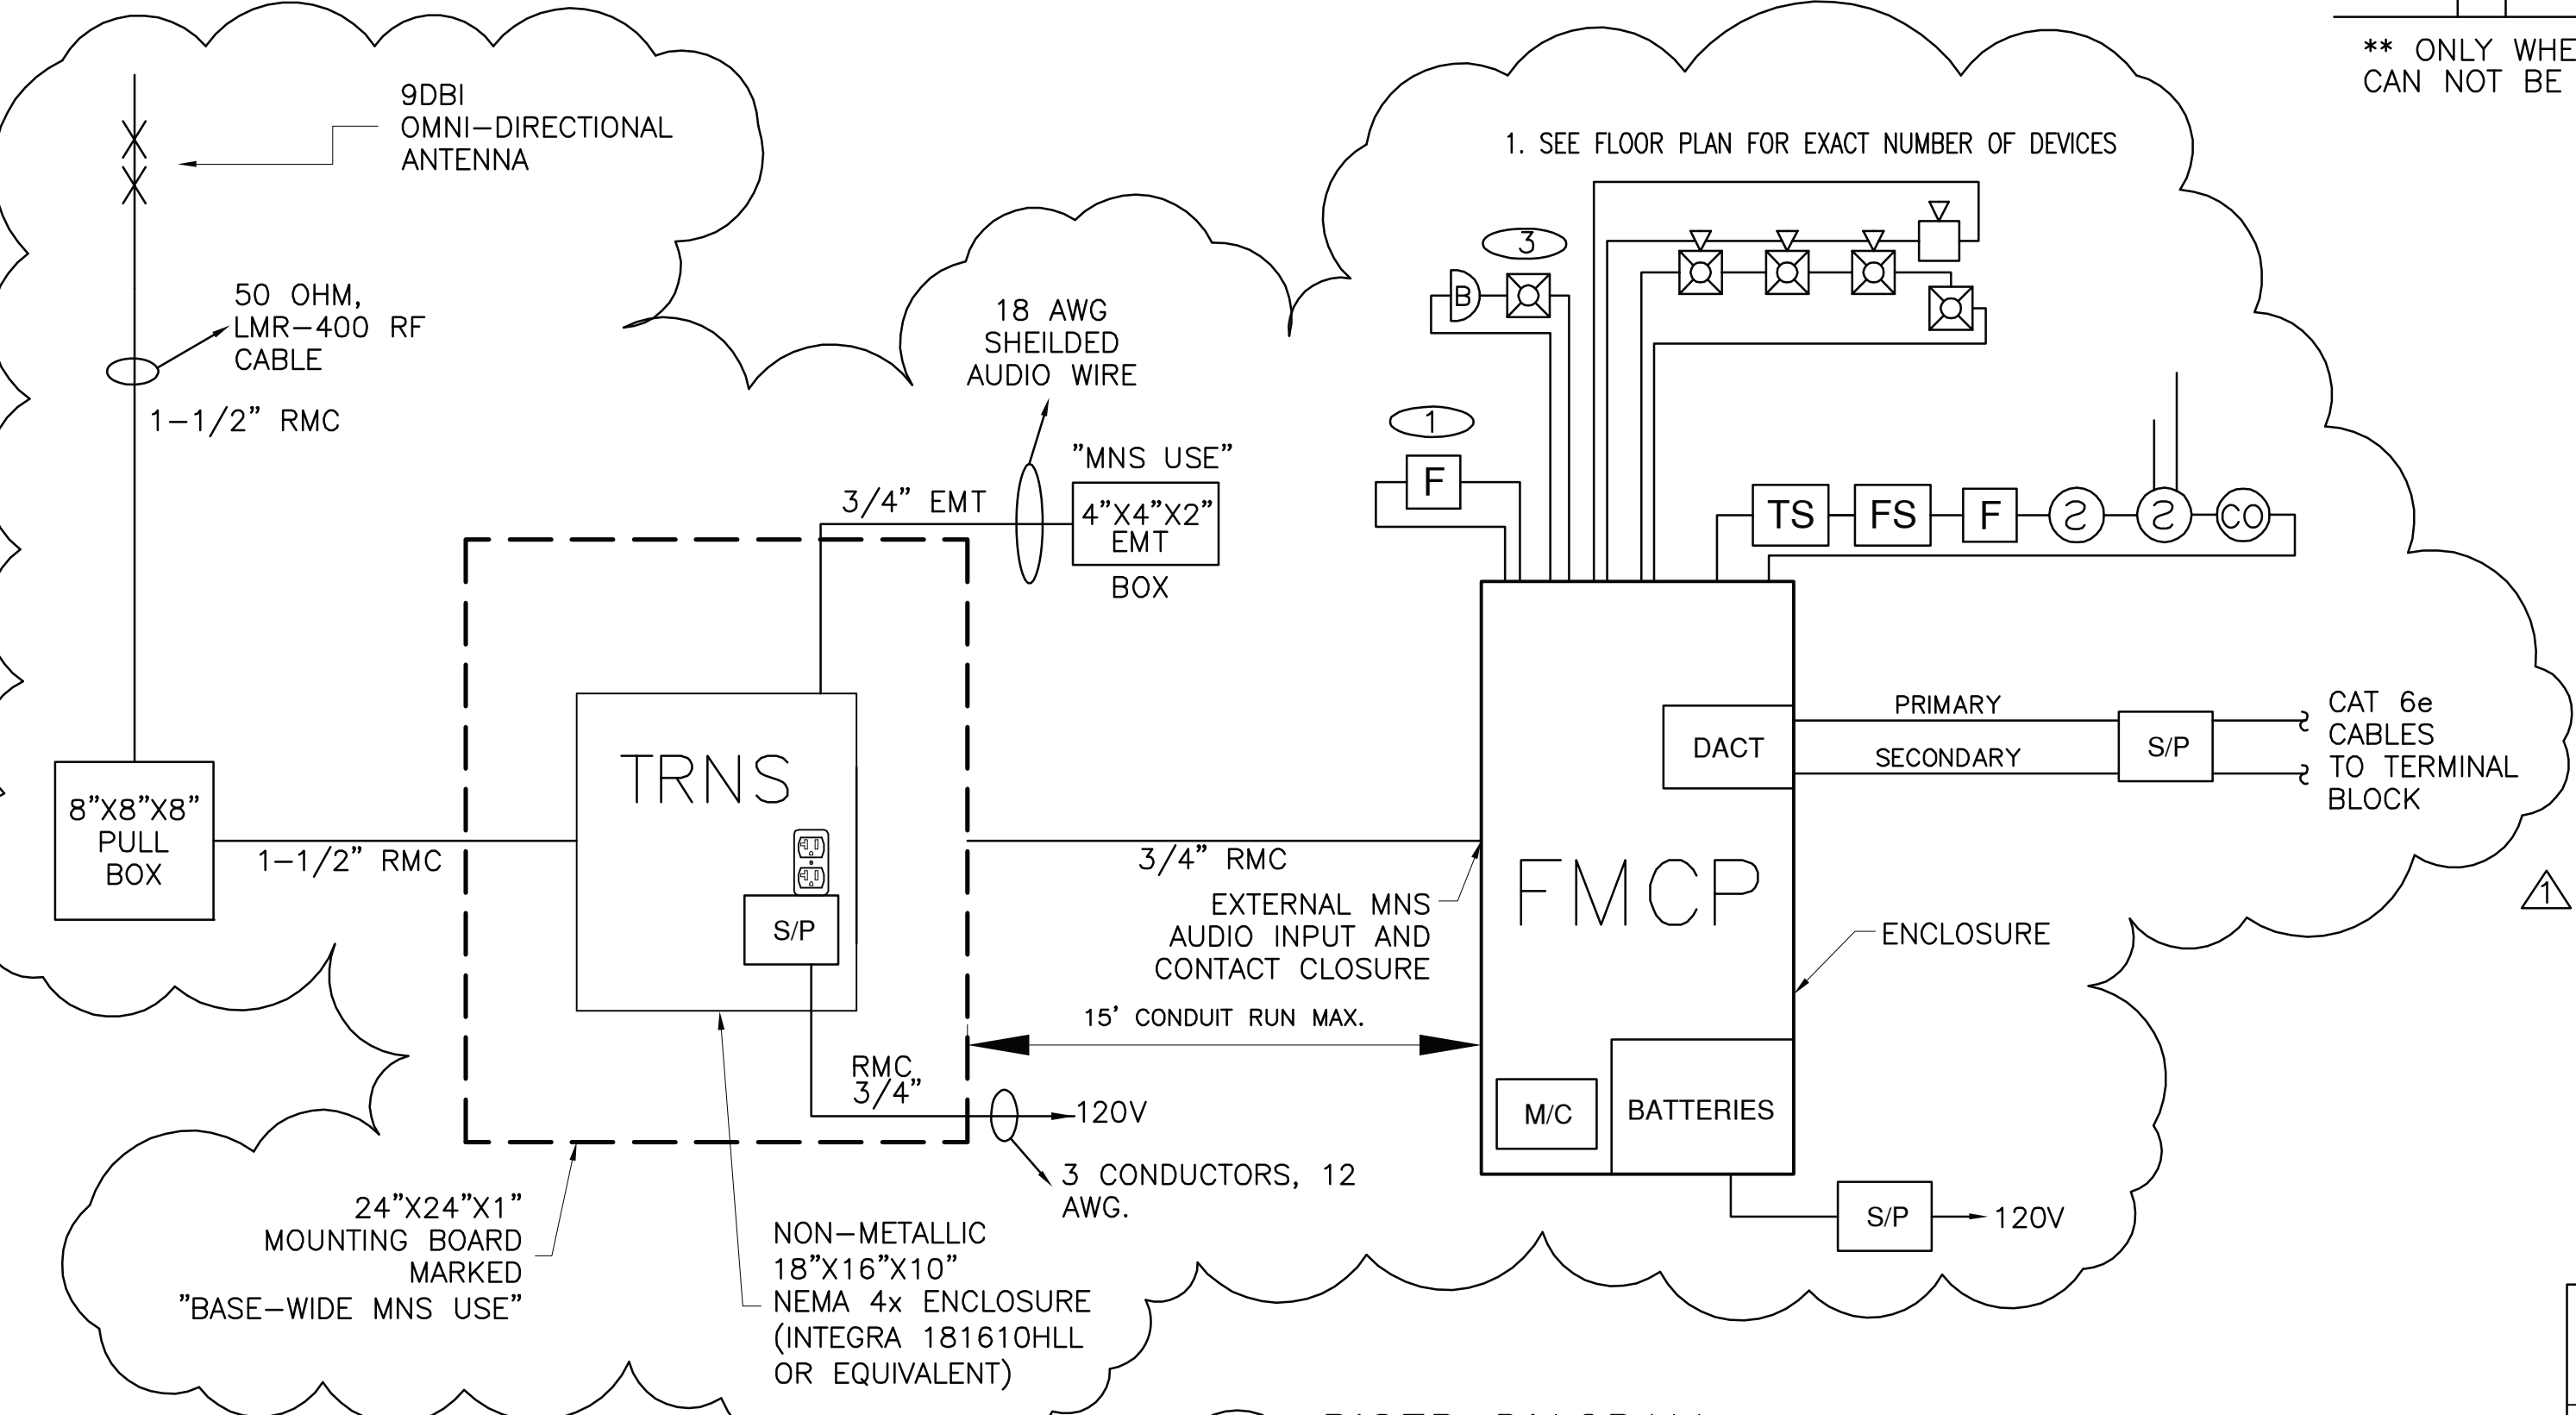


C RISER DIAGRAM
 FA 2 NTS

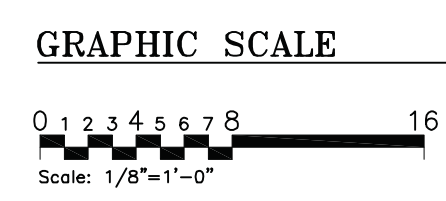

BUILDING SPRINKLERED THROUGHOUT

DISCLOSURE OF INFORMATION
 CONTRACTOR SHALL COMPLY AS FOLLOWS:
 (A) THE CONTRACTOR SHALL NOT RELEASE TO ANYONE OUTSIDE THE CONTRACTOR'S ORGANIZATION ANY UNCLASSIFIED INFORMATION, REGARDLESS OF MEDIUM (E.G., FILM, TAPE, DOCUMENT), PERTAINING TO ANY PART OF THIS CONTRACT OR ANY PROGRAM RELATED TO THIS CONTRACT, UNLESS:
 (1) THE CONTRACTING OFFICER HAS GIVEN PRIOR WRITTEN APPROVAL OR
 (2) THE INFORMATION IS OTHERWISE IN THE PUBLIC DOMAIN BEFORE THE DATE OF RELEASE.
 (B) REQUESTS FOR APPROVAL SHALL IDENTIFY THE SPECIFIC INFORMATION TO BE RELEASED, THE MEDIUM TO BE USED, AND THE PURPOSE FOR THE RELEASE. THE CONTRACTOR SHALL SUBMIT ITS REQUEST TO THE CONTRACTING OFFICER AT LEAST AS MANY DAYS BEFORE THE PROPOSED DATE FOR RELEASE AS THE CONTRACTING OFFICER MAY REQUIRE.
 (C) THE CONTRACTOR AGREES TO INCLUDE A SIMILAR REQUIREMENT IN EACH SUBCONTRACT UNDER HIS CONTRACT. SUBCONTRACTORS SHALL SUBMIT REQUESTS FOR AUTHORIZATION TO RELEASE THROUGH THE PRIME CONTRACTOR TO THE CONTRACTING OFFICER.

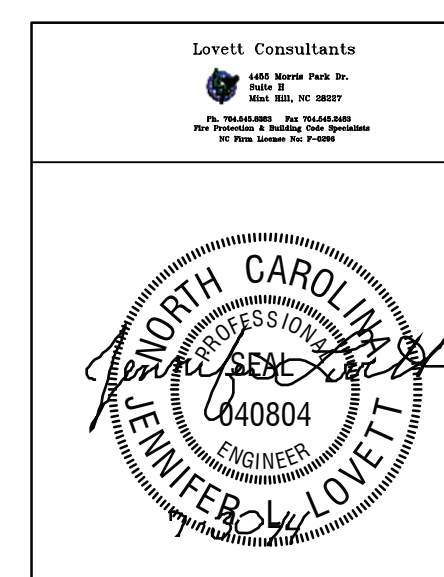

The Walker Group Architecture, Inc. WALKER GROUP ARCHITECTURE
 PO Box 541, New Bern, NC 28563
 252.636.8778 (PHONE)
 252.636.8992 (FAX)

DES. J. LOVETT
 DR. D. NAM
 CHK. K. COLLINS
 SUBMITTED BY: X. XXXXX
 DESIGN DIR. X. XXXXX
 APPROVED: PWO OR OICC DATE

DEPARTMENT OF THE NAVY NAVAL FACILITIES ENGINEERING COMMAND
MARINE CORPS BASE
 CAMP LEJEUNE, NORTH CAROLINA

FA-2

14-0090 INTERIOR AND EXTERIOR REPAIRS, BLDG. FC120
FIRE ALARM RENOVATION FLOOR PLAN

SIZE: CODE IDENT. NO. NAVFAC DRAWING NO. 60015349
 CONST. CONTR. NO. N40085-14-B-0090
 SCALE: NOTED SPEC. 05-14-0090 SHEET 5 OF 41

SYM	REVISIONS	DATE	APPROVED
△	SCOPE OF WORK REVISION/CLARIFICATION	8/13	

LEGEND


- ABOVEGROUND SPRINKLER PIPE
- UF— UNDERGROUND FIRE WATER MAINS
- ⊖ WATER MOTOR GONG
- ⊕ SPRINKLER RISER ASSEMBLY
- > FIRE DEPARTMENT CONNECTION
- ⊗ RPZ BACKFLOW PREVENTER
- SPRINKLER PIPING RISE
- NEW RECESSED CHROME PENDENTS
- EXISTING PENDENTS
- × EXISTING UPRIGHTS
- ⊗ MECH DIFFUSERS
- LIGHT FIXTURE

DEMOLITION NOTES:


1. △
2. REMOVE ALL SPRINKLER HEADS AND ESCUTCHEONS IN ALL AREAS WITH GRIDDED SUSPENDED CEILINGS AND BATTERY ROOM 105. △
3. △
4. DEMO SPRINKLER RISER DOWN STREAM OF INCOMING SUPPLY UP TO HORIZONTAL PIPE RUN TO INCLUDE ALARM VALVE & TRIM, F.D.C. CONNECTION AND WATER MOTOR GONG.
5. CONTRACTOR TO PROPERLY DISPOSE OF REMOVED/DEMOED MATERIAL IN COMPLIANCE WITH ALL LOCAL/STATE AND FEDERAL LAWS.
6. CONTRACTOR TO REPAIR ANY DAMAGE TO THE STRUCTURE OR FINISH CAUSED BY THE DEMOLITION WORK.
7. LOCATION OF HEADS AND SHOWN PIPE ROUTING ARE APPROXIMATE. CONTRACTOR TO VERIFY PRIOR TO BEGINNING WORK. △



A FIRE PROTECTION DEMOLITION 1ST FLOOR PLAN
 1/8" = 1'-0"

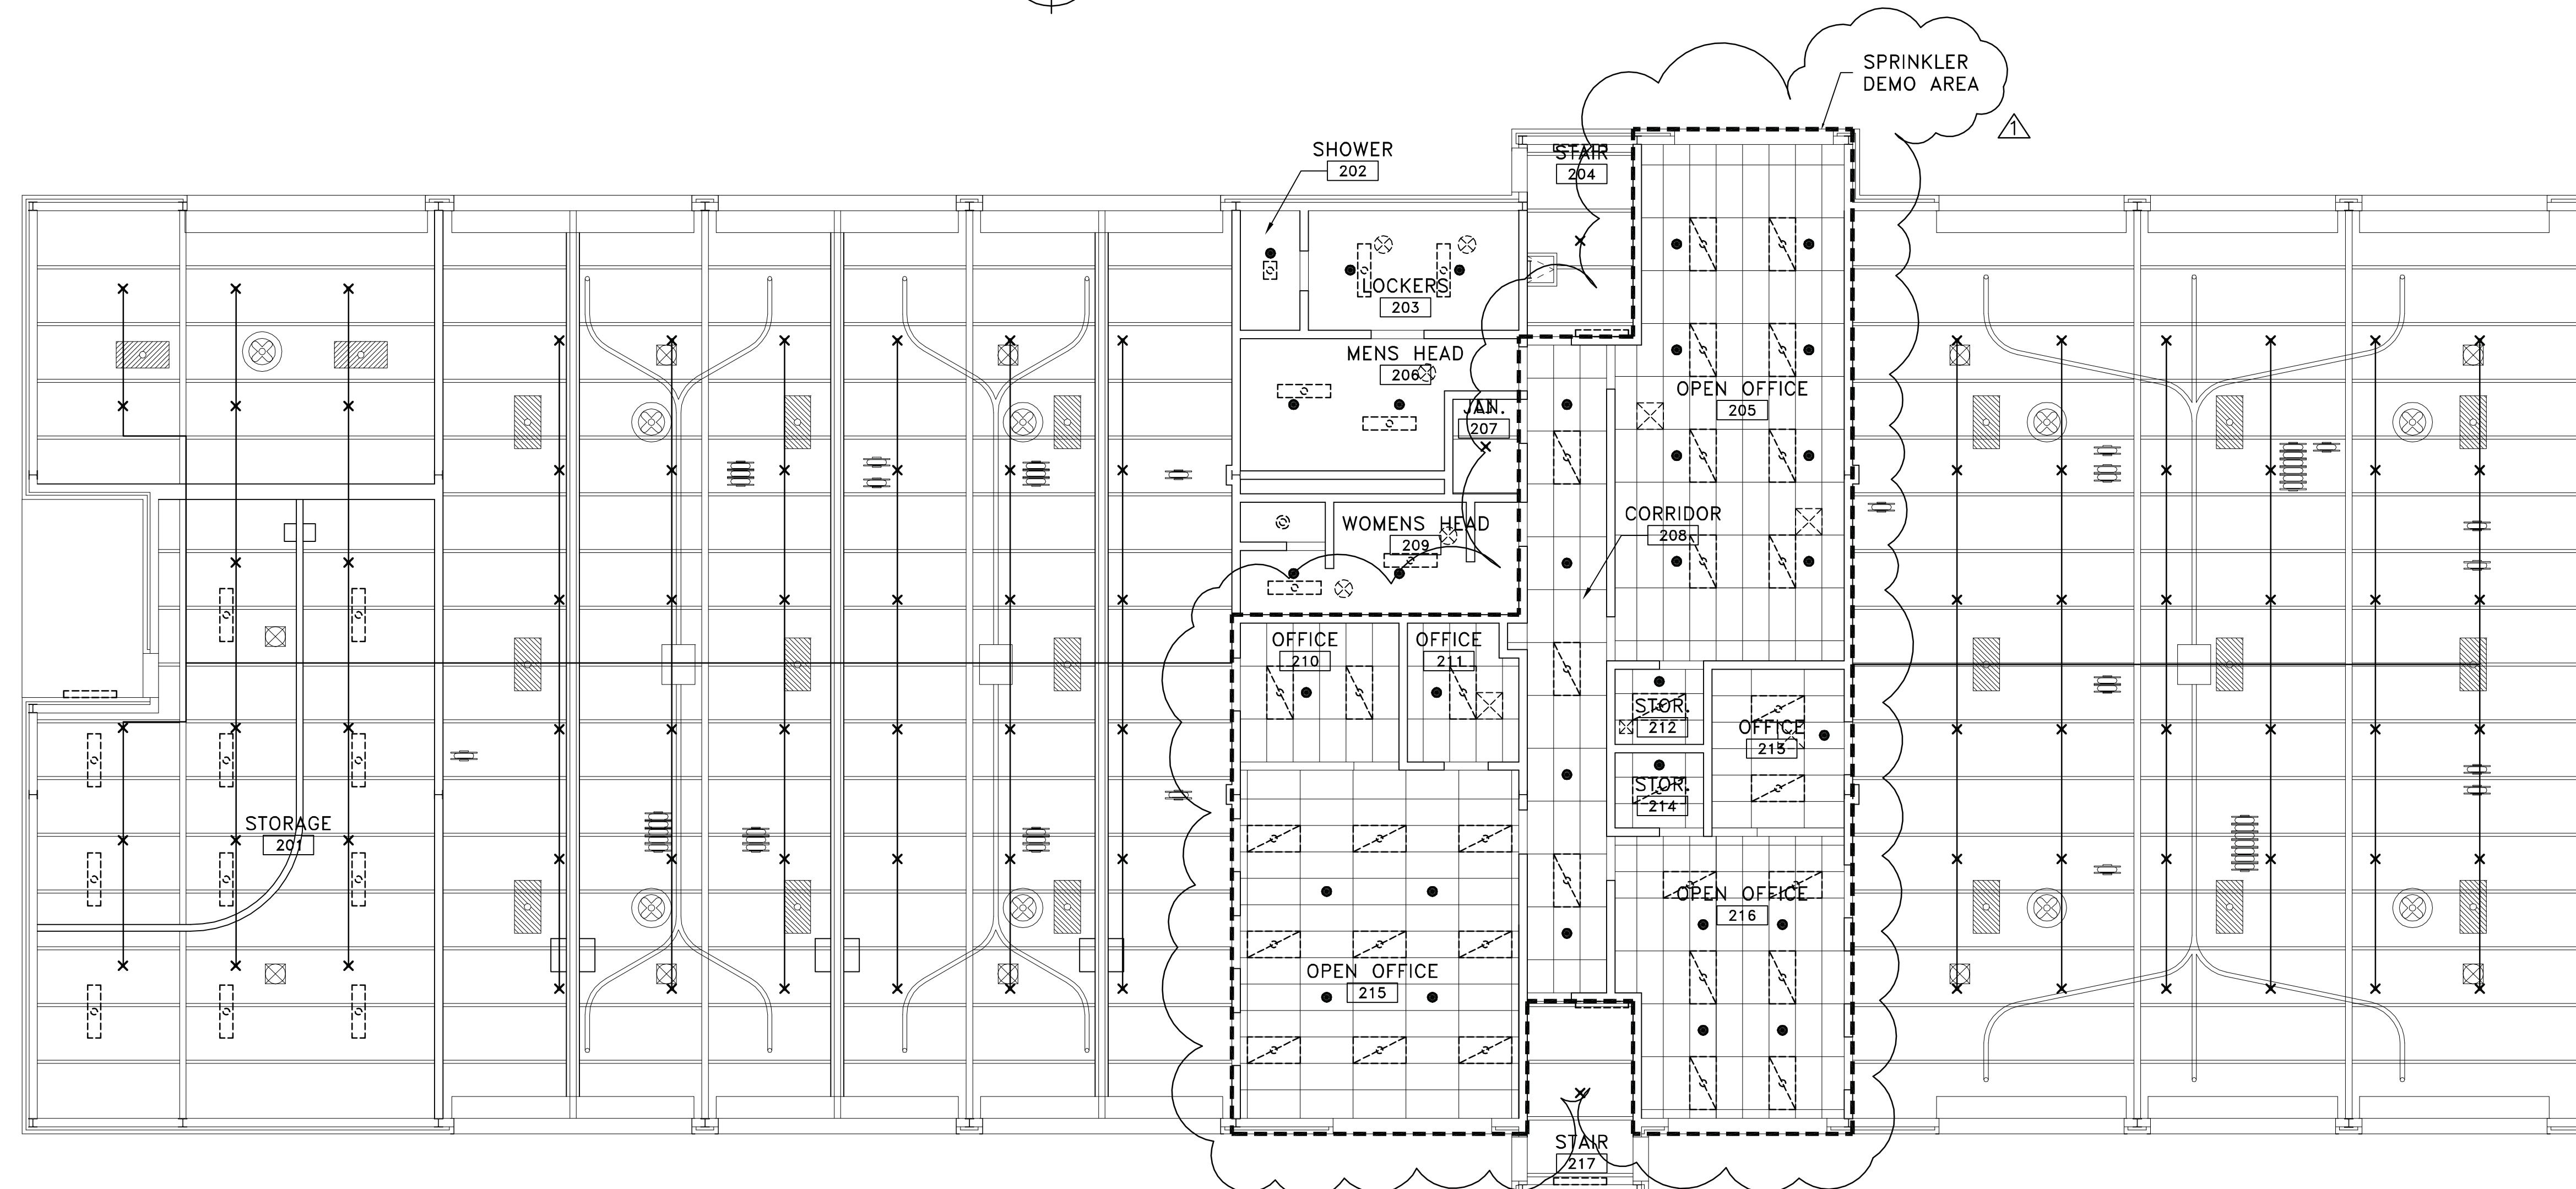

B FIRE PROTECTION DEMOLITION 2ND FLOOR PLAN
 1/8" = 1'-0"

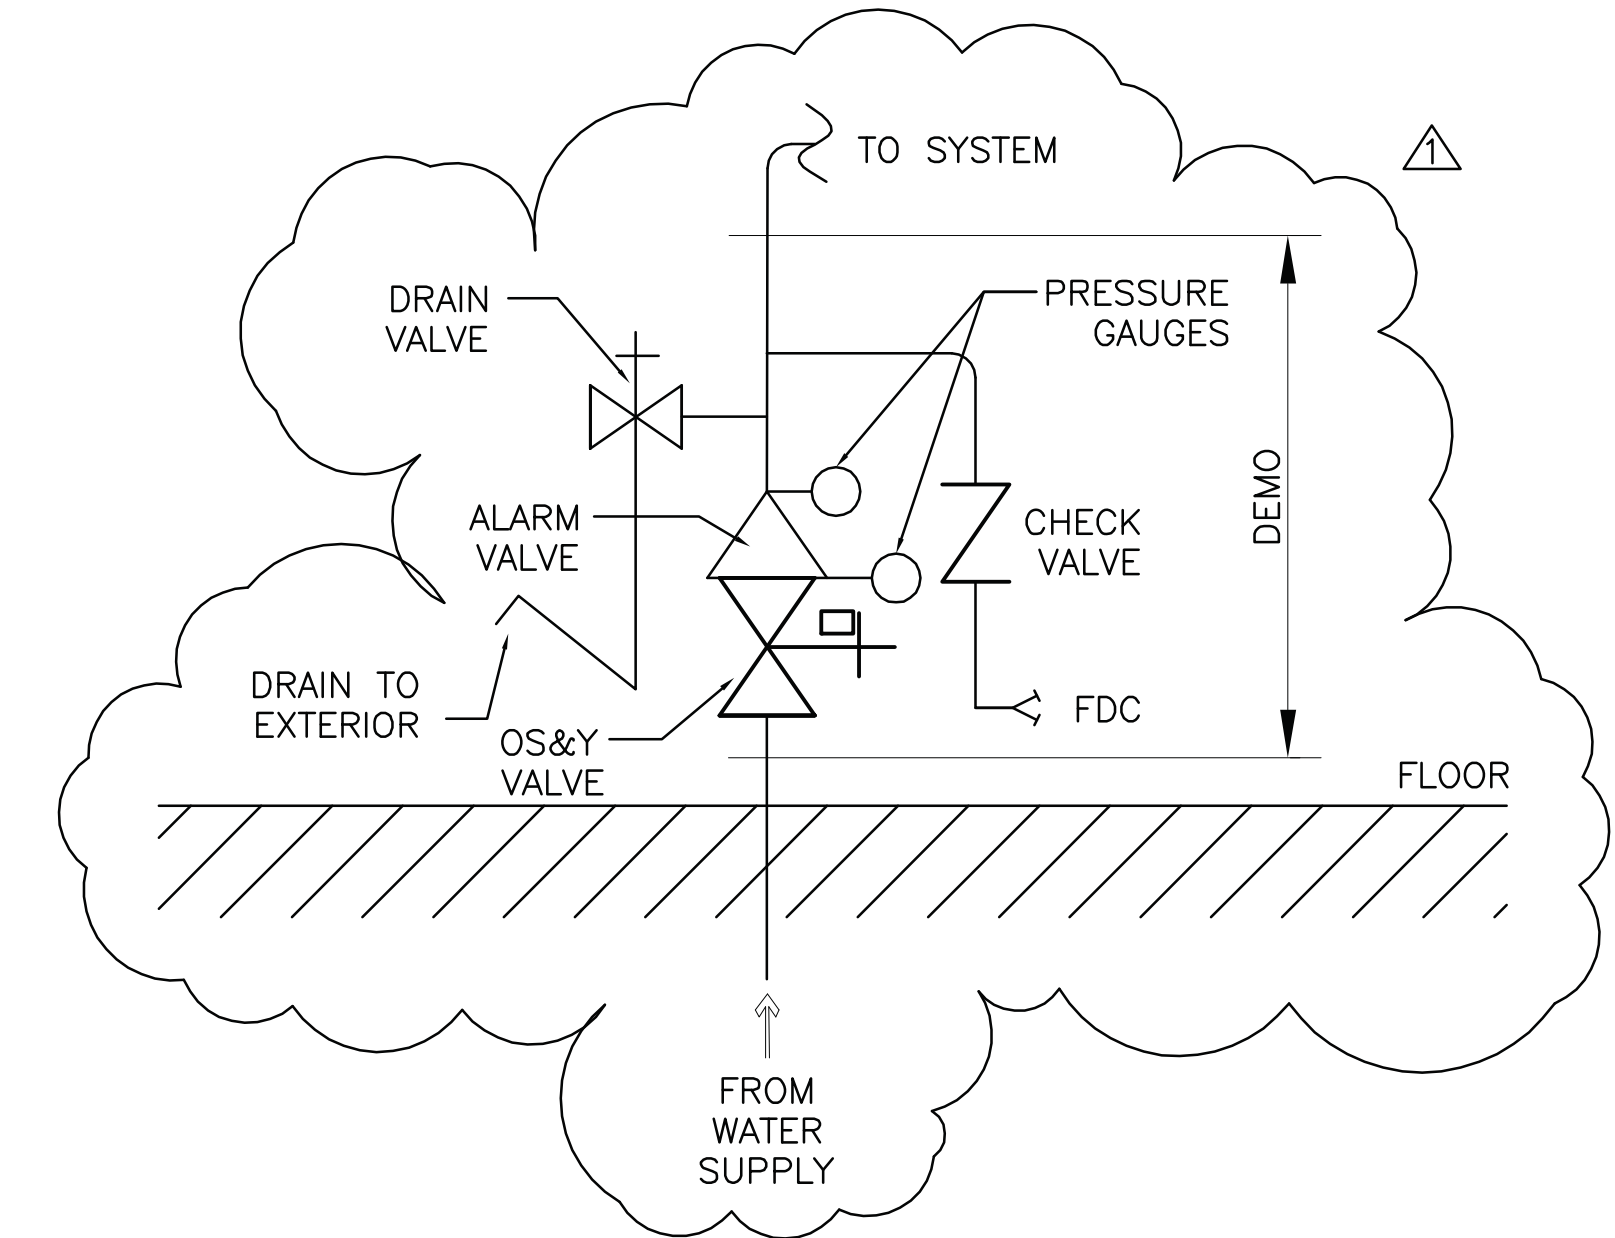

C EXISTING SPRINKLER RISER DIAGRAM
 NTS

DISCLOSURE OF INFORMATION
 CONTRACTOR SHALL COMPLY AS FOLLOWS:
 (A) THE CONTRACTOR SHALL NOT RELEASE TO ANYONE OUTSIDE THE CONTRACTOR'S ORGANIZATION ANY UNCLASSIFIED INFORMATION, REGARDLESS OF MEDIUM (E.G., FILM, TAPE, DOCUMENT), PERTAINING TO ANY PART OF THIS CONTRACT OR ANY PROGRAM RELATED TO THIS CONTRACT, UNLESS:
 (1) THE CONTRACTING OFFICER HAS GIVEN PRIOR WRITTEN APPROVAL OR
 (2) THE INFORMATION IS OTHERWISE IN THE PUBLIC DOMAIN BEFORE THE DATE OF RELEASE.
 (B) REQUESTS FOR APPROVAL SHALL IDENTIFY THE SPECIFIC INFORMATION TO BE RELEASED, THE MEDIUM TO BE USED, AND THE PURPOSE FOR THE RELEASE. THE CONTRACTOR SHALL SUBMIT ITS REQUEST TO THE CONTRACTING OFFICER AT LEAST 45 DAYS BEFORE THE PROPOSED DATE FOR RELEASE.
 (C) THE CONTRACTOR AGREES TO INCLUDE A SIMILAR REQUIREMENT IN EACH SUBCONTRACT UNDER HIS CONTRACT. SUBCONTRACTORS SHALL SUBMIT REQUESTS FOR AUTHORIZATION TO RELEASE THROUGH THE PRIME CONTRACTOR TO THE CONTRACTING OFFICER.

FP-1

	The Walker Group Architecture, Inc. WALKER GROUP ARCHITECTURE P.O. Box 541, New Bern, NC 28563 252.636.8778 (PHONE) 252.636.8992 (FAX)	DEPARTMENT OF THE NAVY NAVAL FACILITIES ENGINEERING COMMAND MARINE CORPS BASE CAMP LEJEUNE, NORTH CAROLINA
	DES. J. LOVETT DR. D. NAM CHK. K. COLLINS SUBMITTED BY: X. XXXXX DESIGN DIR. X. XXXXX APPROVED: PWO OR OICC DATE:	14-0090 INTERIOR AND EXTERIOR REPAIRS, BLDG. FC120 FIRE PROTECTION DEMOLITION FLOOR PLAN SIZE: CODE IDENT. NO: NAVFAC DRAWING NO. 60015350 CONST. CONTR. NO. N40085-14-B-0090 SCALE: NOTED SPEC. 05-14-0090 SHEET 6 OF 41


GRAPHIC SCALE
 0 1 2 3 4 5 6 7 8 16
 Scale: 1/8"=1'-0"

BUILDING SPRINKLERED THROUGHOUT


SYM	REVISIONS	DATE	APPROVED
△	SCOPE OF WORK REVISION/CLARIFICATION	8/13	

GENERAL NOTES:


1. SEE SHEET FP-1 FOR LEGEND.
2. INSTALL NEW SPRINKLER HEADS AND ESCUTCHEONS IN AREAS WITH GRIDDED CEILING AREAS, AND INSTALL NEW BACKFLOW PREVENTER, AND COMPLETE SYSTEM RISER WITH ALARM CHECK VALVE, TRIM, FDC, AND ALARM DEVICES IN ACCORDANCE WITH NFPA 13. PROVIDE A COMPLETE OPERATING SYSTEM.
3. FINAL SPRINKLER PLACEMENT, PIPE ROUTING, AND QUANTITY SHALL BE COORDINATED BETWEEN SPRINKLER CONTRACTOR AND GENERAL CONTRACTOR. PIPE ROUTING SHOWN IS SUGGESTED. FINAL ROUTING TO BE SHOWN AND APPROVED THROUGH THE SHOP DRAWINGS.
- 4.
5. CONTRACTOR TO REMOVE HEAD(S) IN BATTERY SHOP 105 AND REPLACE WITH CORROSION RESISTANT HEAD(S).
- 6.
- 7.
- 8.
9. CONTRACTOR SHALL FIELD VERIFY EXISTING CONDITIONS THAT MAY AFFECT THE SYSTEM INSTALLATION OR COMPLIANCE WITH NFPA 13, AND NOTIFY THE CONTRACTING OFFICER PRIOR TO BEGINNING WORK.
- 10.
11. ALL VALVES SHALL BE READILY ACCESSIBLE FOR OPERATION.
12. WATER FLOW TEST; STATIC - 55 PSI; RESIDUAL - 52 PSI; FLOW- 1087 GPM. WATER FLOW TEST PERFORMED ON MAY 22, 2014.
13. NEW PIPE TO BE SCHEDULE 40 BLACK STEEL FOR PIPES SMALLER THAN 2" AND MAY BE SCHEDULE 10 FOR PIPE 2" OR LARGER.
14. PENDENTS AND SIDEWALL SPRINKLERS WITH ESCUTCHEONS SHALL BE SEMI-RECESSED WITH CHROME FINISH.
15. PIPE TO BE RUN CONCEALED ABOVE CEILINGS WHERE PRACTICAL.
16. EXTENDED COVERAGE SPRINKLERS ARE NOT PERMITTED.
17. ROUTE PIPE AND LOCATE FDC, DRAIN AND WATER GONG TO UTILIZE EXISTING EXTERIOR WALL PENETRATIONS WHERE PRACTICAL. UNUSED PENETRATIONS TO BE PATCHED TO MATCH EXISTING WALL.
18. NEW CEILING GRID SHOULD MATCH EXISTING LAYOUT AND HEIGHT SUCH THAT REPIPING SHOULD NOT BE REQUIRED. CONTRACTOR TO MODIFY PIPING AS REQUIRED TO MATCH NEW GRID AND MEET NFPA 13 FOR SPRINKLER COVERAGE.
- 19.

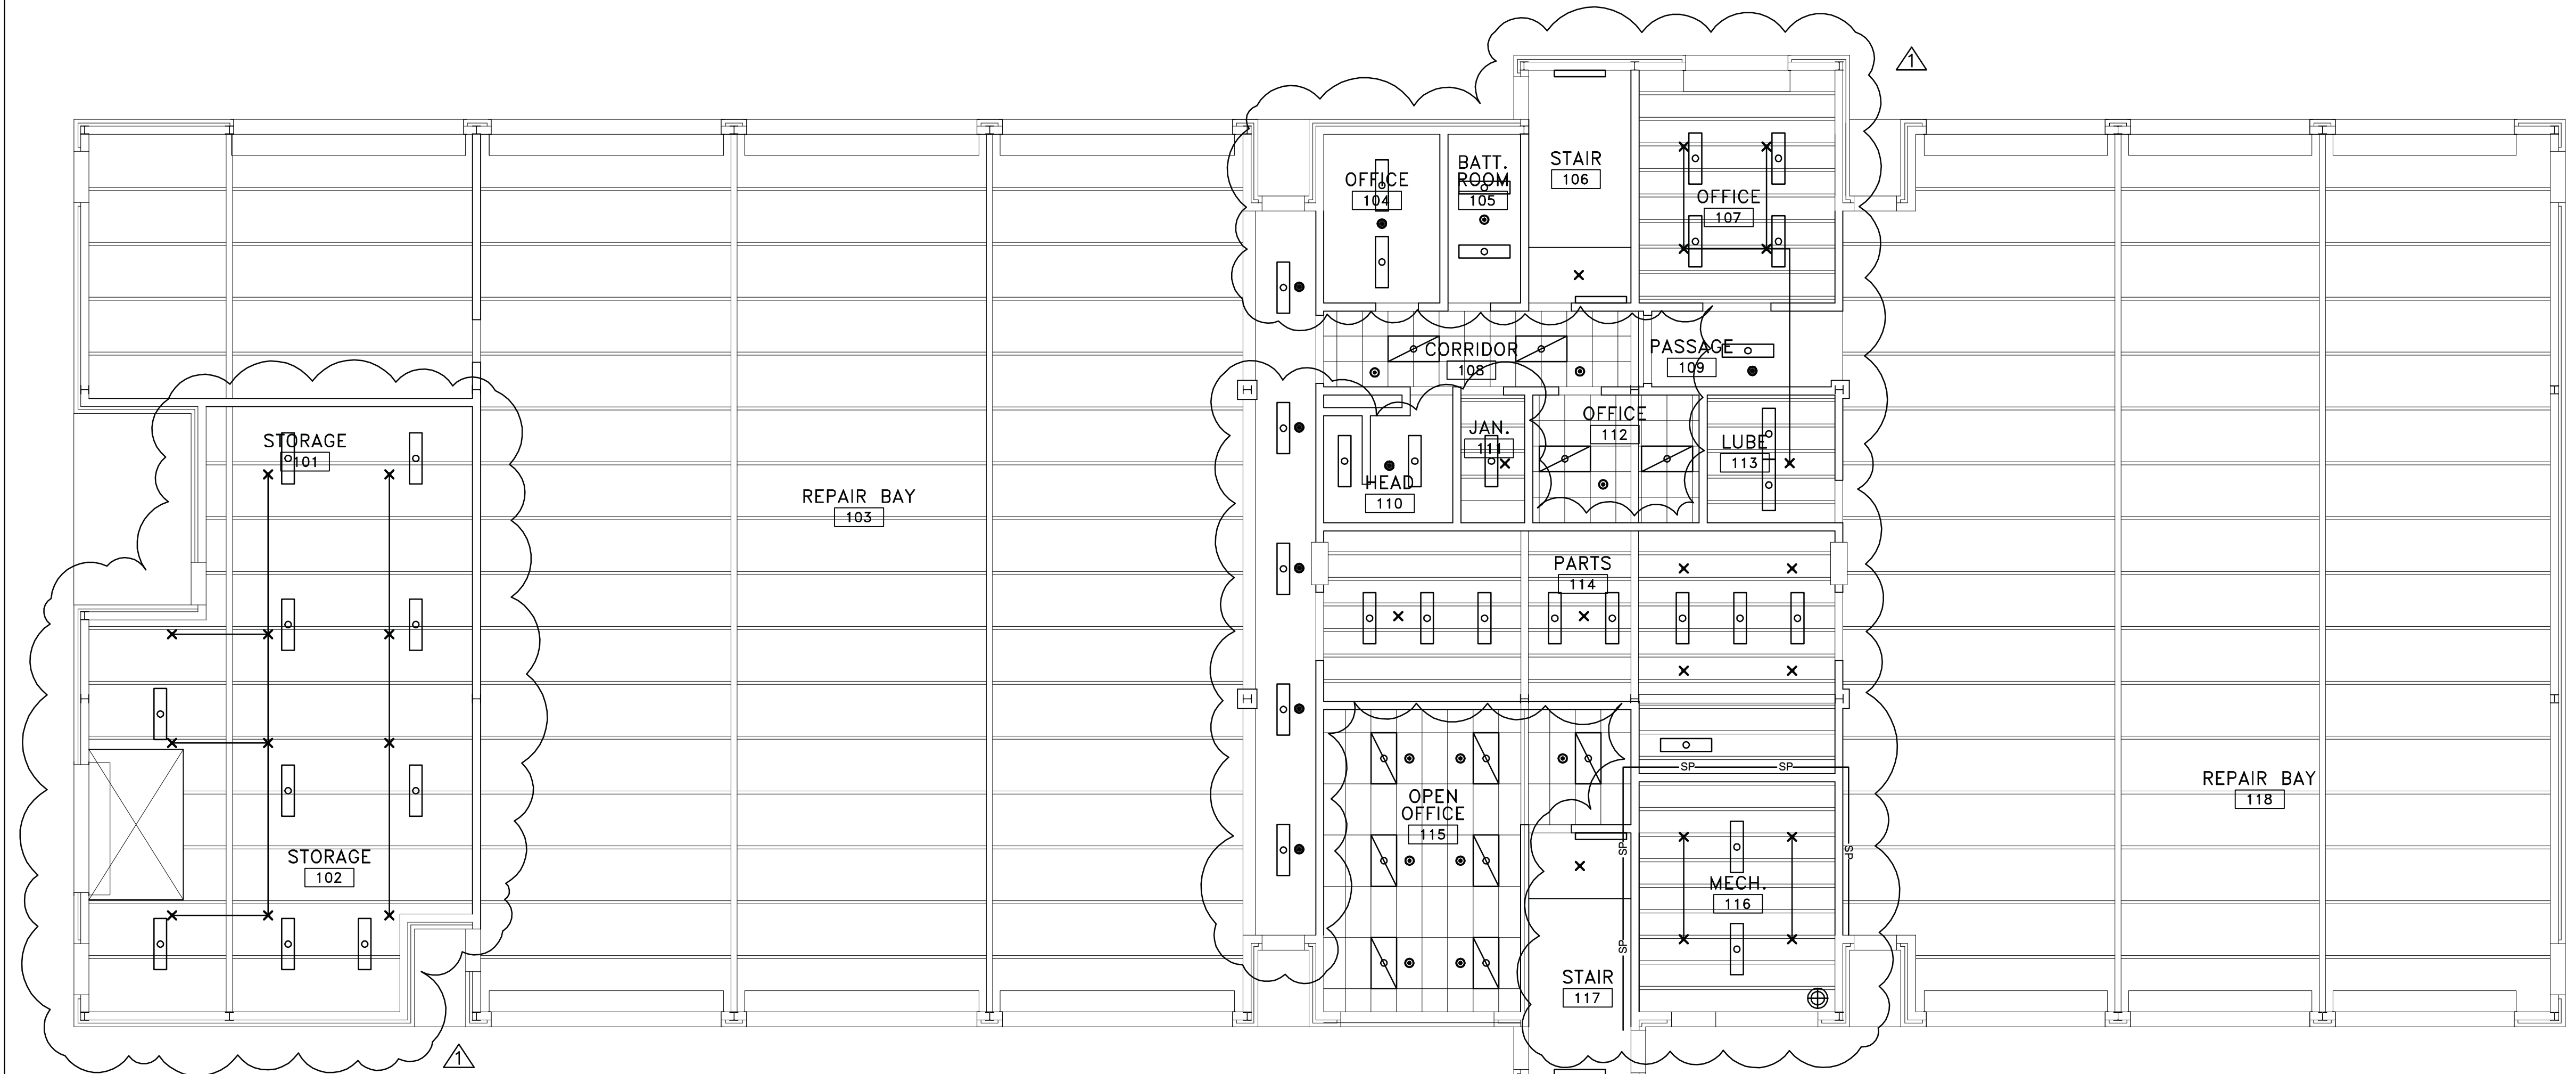

A FIRE PROTECTION RENOVATION 1ST FLOOR PLAN
 1/8" = 1'-0" NORTH

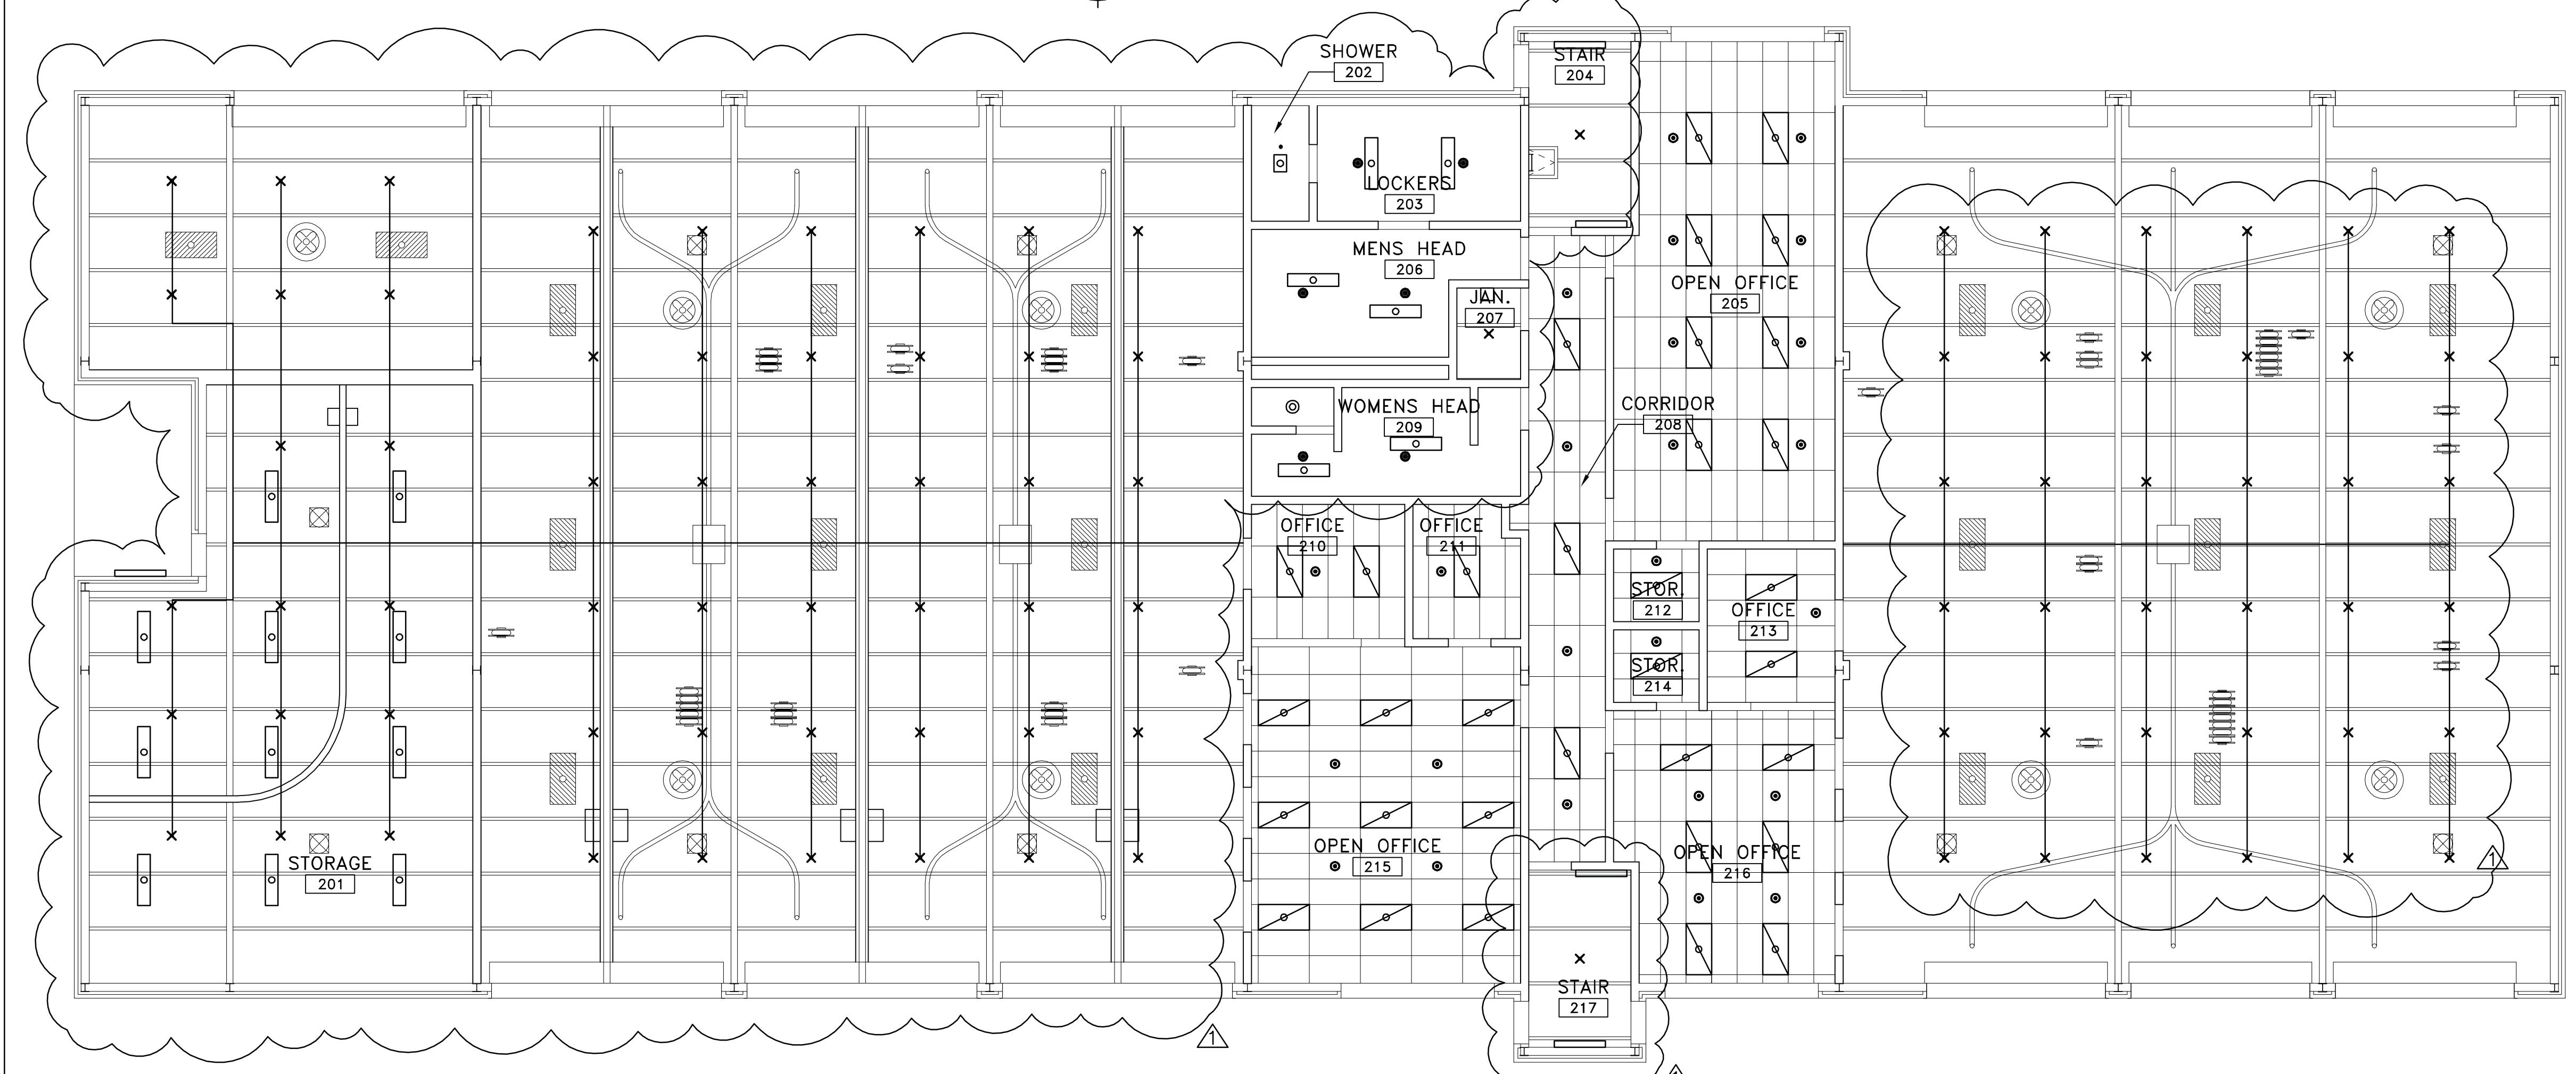


B FIRE PROTECTION RENOVATION 2ND FLOOR PLAN
 1/8" = 1'-0" NORTH

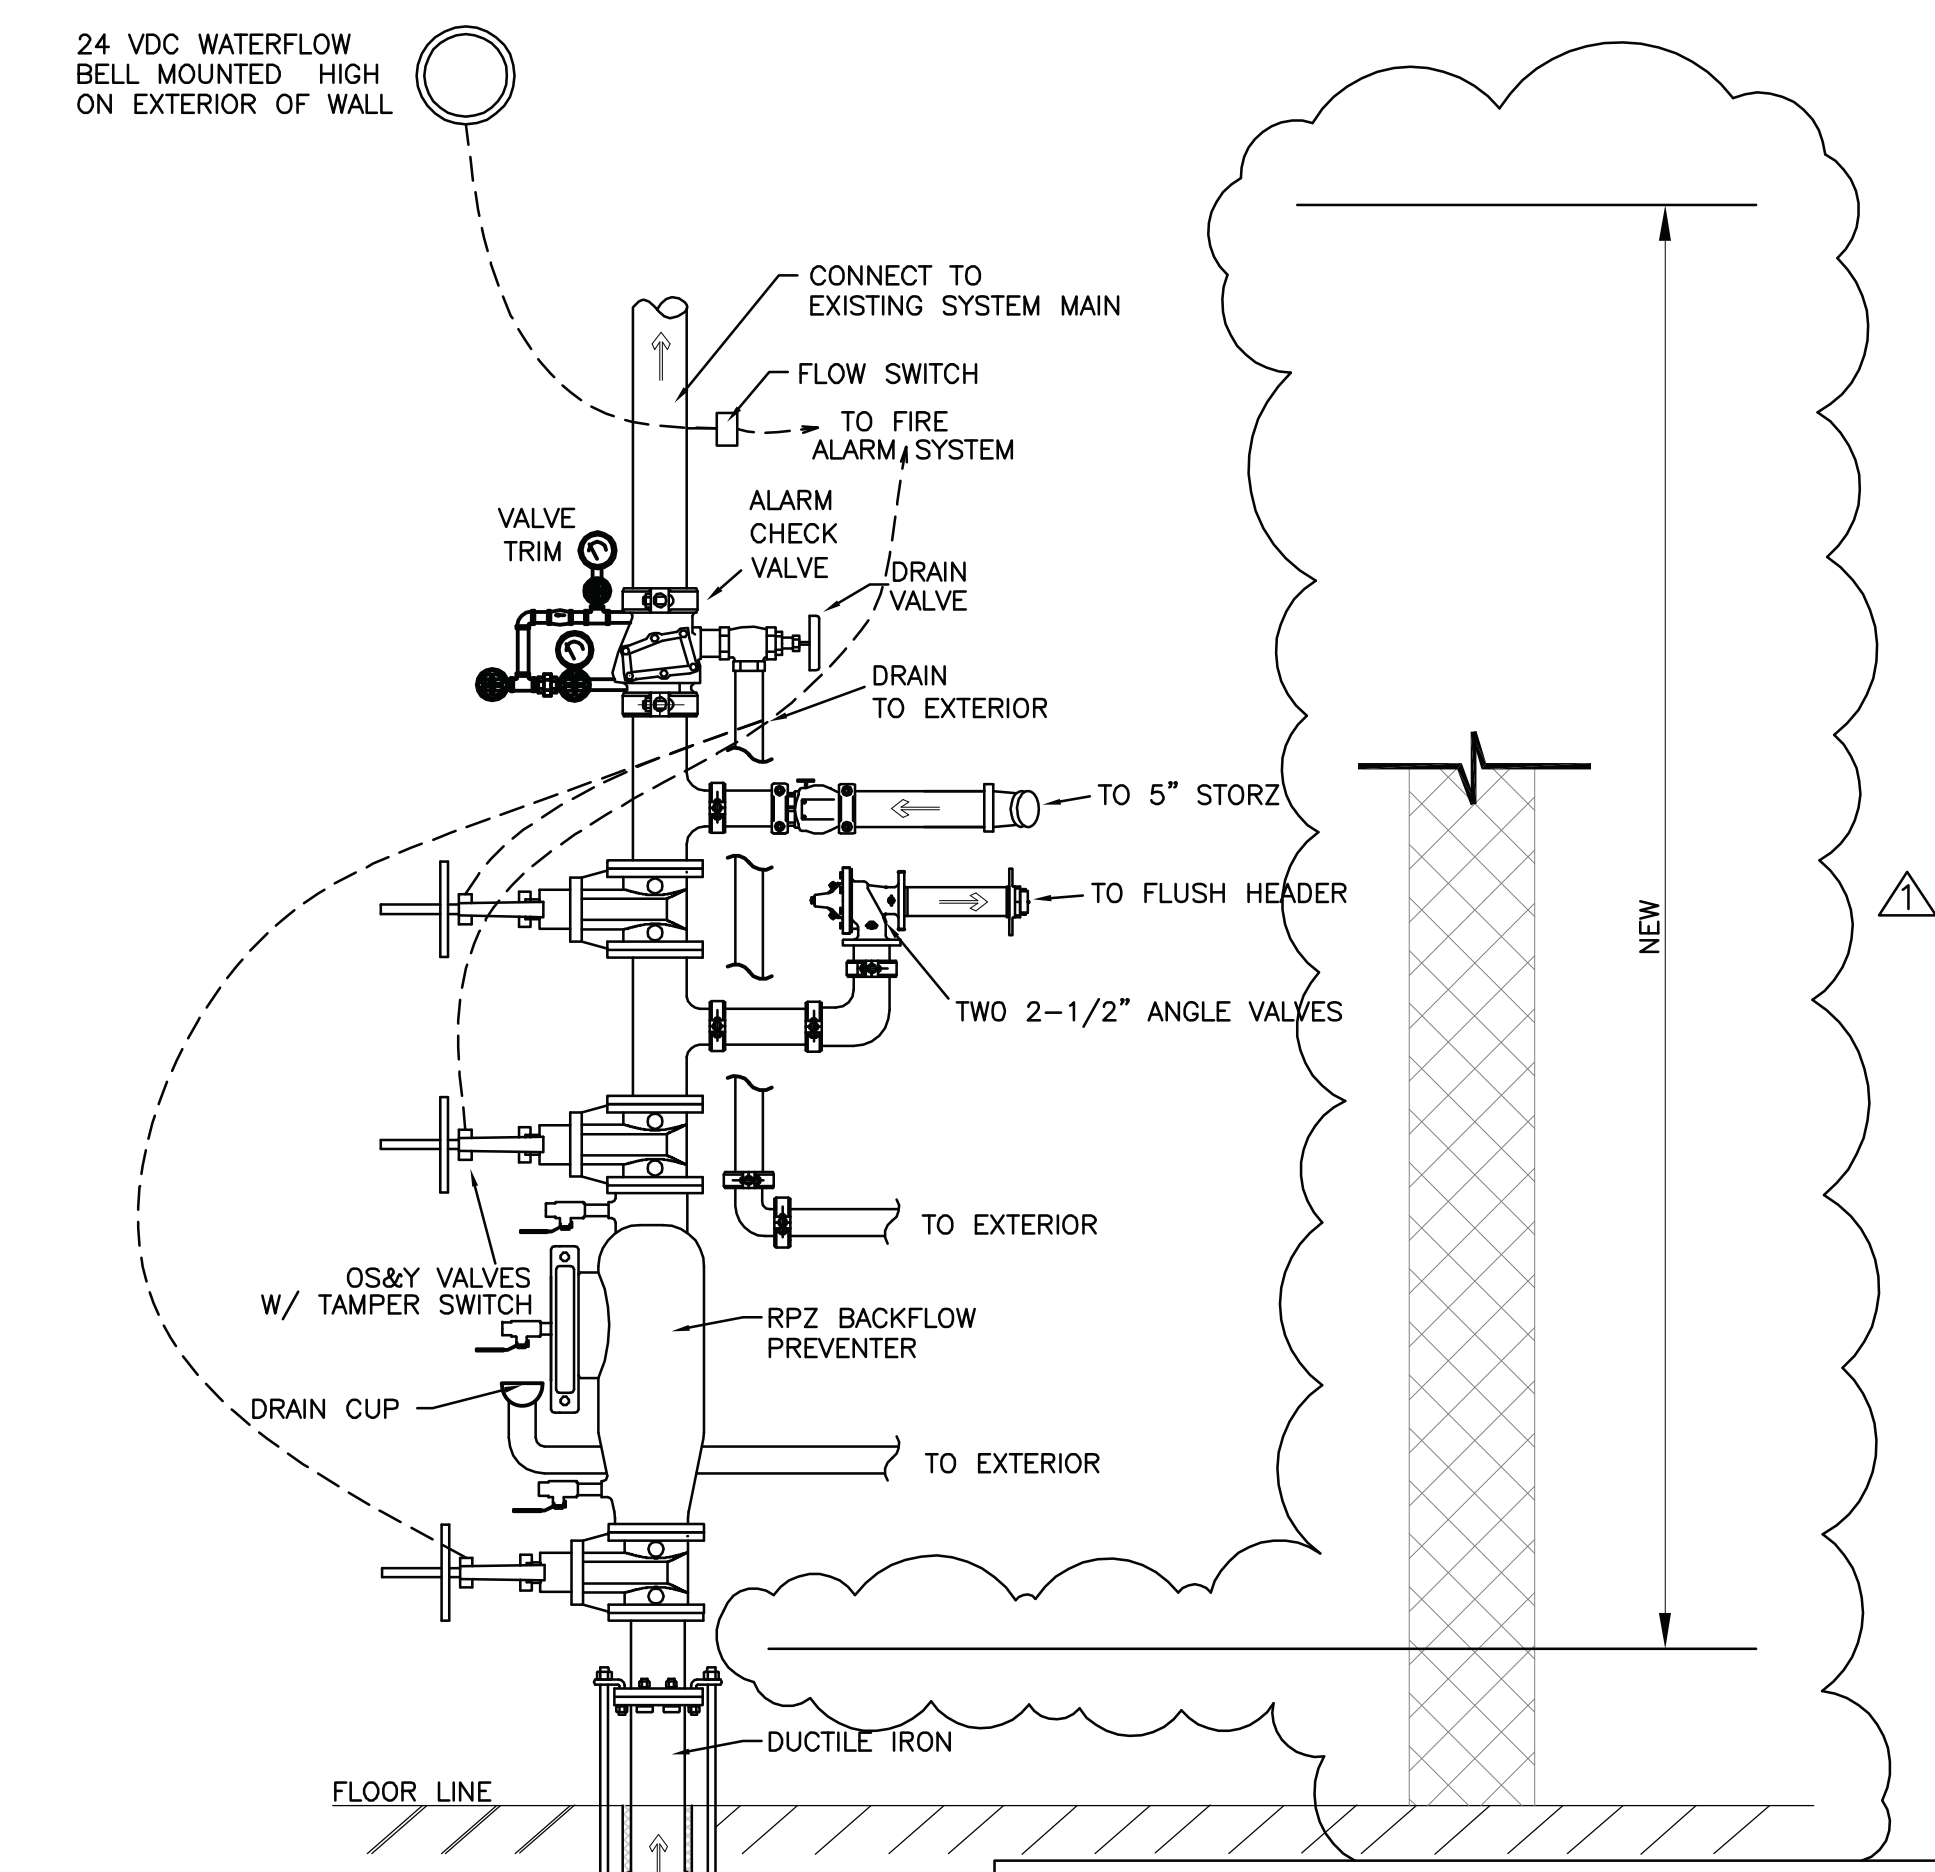


C NEW WET PIPE RISER
 NTS

DISCLOSURE OF INFORMATION:
 CONTRACTOR SHALL COMPLY AS FOLLOWS:
 (A) THE CONTRACTOR SHALL NOT RELEASE TO ANYONE OUTSIDE THE CONTRACTOR'S ORGANIZATION ANY UNCLASSIFIED INFORMATION, REGARDLESS OF MEDIUM (E.G., FILM, TAPE, DOCUMENT), PERTAINING TO ANY PART OF THIS CONTRACT OR ANY PROGRAM RELATED TO THIS CONTRACT, UNLESS:
 (1) THE CONTRACTING OFFICER HAS GIVEN PRIOR WRITTEN APPROVAL OR
 (2) THE INFORMATION IS OTHERWISE IN THE PUBLIC DOMAIN BEFORE THE DATE OF RELEASE.
 (B) REQUESTS FOR APPROVAL SHALL INCLUDE THE SPECIFIC INFORMATION TO BE RELEASED, THE MEDIUM TO BE USED, AND THE PURPOSE FOR THE RELEASE. THE CONTRACTOR SHALL SUBMIT ITS REQUEST TO THE CONTRACTING OFFICER AT LEAST 45 DAYS BEFORE THE PROPOSED DATE FOR RELEASE.
 (C) THE CONTRACTOR AGREES TO INCLUDE A SIMILAR REQUIREMENT IN EACH SUBCONTRACT UNDER HIS CONTRACT. SUBCONTRACTORS SHALL SUBMIT REQUESTS FOR AUTHORIZATION TO RELEASE THROUGH THE PRIME CONTRACTOR TO THE CONTRACTING OFFICER.

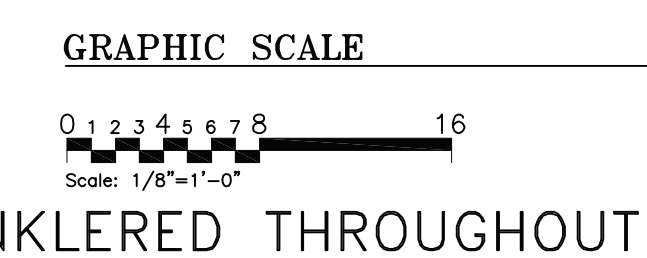

BUILDING SPRINKLERED THROUGHOUT

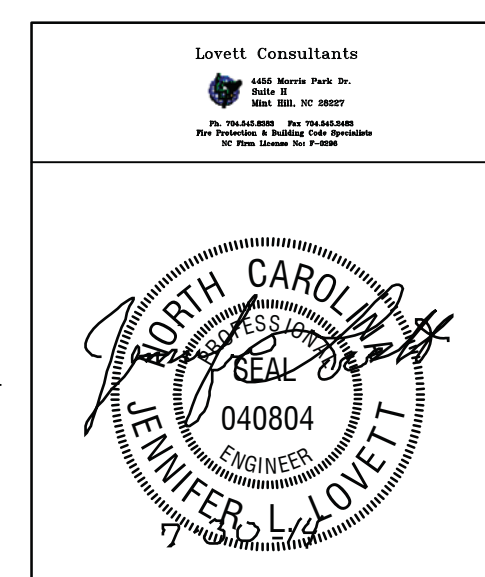

The Walker Group Architecture, Inc. WALKER GROUP ARCHITECTURE P.O. Box 541, New Bern, NC 28563 252.636.8778 (PHONE) 252.636.8992 (FAX)	DEPARTMENT OF THE NAVY NAVAL FACILITIES ENGINEERING COMMAND MARINE CORPS BASE CAMP LEJEUNE, NORTH CAROLINA
	FP-2 14-0090 INTERIOR AND EXTERIOR REPAIRS, BLDG. FC120 FIRE PROTECTION RENOVATION FLOOR PLAN
DES. J. LOVETT DR. D. NAM CHK. K. COLLINS SUBMITTED BY: X. XXXXX DESIGN DIR. X. XXXXX APPROVED: PWO OR OICC	NAVFAC DRAWING NO. 60015351 CONST. CONTR. NO. N40085-14-B-0090 SCALE: NOTED SPEC. 05-14-0090 SHEET 7 OF 41